

*Risk analysis strategies in the water utility sector: an inventory  
of applications for better and more credible decision-making*

MacGillivray, B.H., Hamilton, P.D., Strutt, J.E. and Pollard, S.J.T.\*

*School of Water Sciences, Cranfield University, Cranfield, Bedfordshire, MK43 0AL,  
UK.*

*\* Corresponding author*

**ABSTRACT**

Financial pressures, regulatory reform and sectoral restructuring are requiring water utilities to move from technically inclined, risk-averse management approaches toward more commercial, business-oriented practices. Risk analysis strategies and techniques traditionally applied to public health protection are now seeing broader application for asset management, assessing competition risks and potential threats to the security of supplies. Water utility managers have to consider these risks alongside one another and employ a range of techniques and devise business plans that prioritise resources on the basis of risk. We present a comprehensive review of risk analysis and management strategies for application in the water utility sector at the strategic, programme, and operational levels of decision making.

**Keywords:** decision making, risk analysis, utilities, water safety plans.

# 1 INTRODUCTION

## 3 A. Background

5 Providing wholesome, affordable and safe drinking water that has the trust of  
6 customers are the overarching goals of the water utility sector. The sector has publicly  
7 stated<sup>8</sup> that achieving this requires, at a minimum, that water is safe in microbiological  
8 and chemical terms; that it is acceptable to consumers in terms of taste, odour and  
9 appearance; and that the supply is reliable in terms of quality and quantity. Delivering  
10 these objectives in the context of an increasingly demanding consumer and regulatory  
11 environment, under constraints imposed by ageing infrastructure and the trend  
12 towards financial self-sufficiency is challenging. Many within the industry, spurred  
13 on by developments in international regulation and guidance, are now promoting a  
14 business-wide approach to risk management as a means to ease and exploit this  
15 transition (*e.g.* Lifton and Smeaton<sup>82</sup>). In practice, water quality managers and  
16 internal audit functions within the sector are working more closely to address issues of  
17 business risk and many of the larger international water companies now have ‘group  
18 risk managers’ in place to manage business and consumer risks within a single  
19 portfolio. Implementation of this business-wide approach to risk management is not  
20 straightforward, however - it requires:<sup>121</sup>

- 22 (i) integrated frameworks for the management of internal risks (*e.g.* from  
23 ageing infrastructure) and external risks (*e.g.* from ‘competitor’ actions) to  
24 the utility;
- 25 (ii) the support of Board level, executive management and operational staff as  
26 well as that of external stakeholders; and

1           (iii) the effective communication of risk and engagement within decision-  
2           making processes both within companies and with external stakeholders.

3

4   Furthermore, as illustrated in this review, there are potential tensions between  
5   managing the risks of a commercial water business and the overarching public health  
6   goal of the water industry, stated above. Critically in this regard, the transition to an  
7   explicit risk management philosophy within the water utility sector is now reflected in  
8   recent revisions to the World Health Organisation's (WHO) Guidelines for Drinking  
9   Water Quality.<sup>167,168,45</sup> This is placing an emphasis on the development and  
10   implementation of 'water safety plans' for water quality management and, within  
11   these, the application of risk frameworks and risk tools such as the 'hazard analysis  
12   and critical control points' (HACCP)<sup>34,64</sup> approach as a basis for prioritising risk  
13   management measures within the water supply chain from catchment to tap. The risk  
14   management approach is becoming increasingly embedded within utilities and with it  
15   a maturing view of risk analysis, shifting from that of a one-off technique to 'placate'  
16   regulators towards that of a practical methodology to facilitate process control,  
17   optimisation and corporate decision-making within a cost-effective framework.  
18   Despite a growing consensus, there remain significant barriers to the implementation  
19   of risk management within utilities. These can be categorised as business-related, the  
20   challenge of integrating risk management within organisational cultures and decision-  
21   making processes (*e.g.* Pollard *et al.*<sup>121</sup>); and technical, relating to the selection and  
22   application of risk analysis tools. One of the key difficulties all organisations face in  
23   implementing risk management is managing the interfaces between high level  
24   corporate objectives, business plans and operational reality. Here then, we critically  
25   review the risk analysis strategies and tools and techniques available for risk analysis  
26   within the sector, with particular emphasis on decision-making at the corporate

(strategic), business (programme level) and operational levels in water utilities. Necessarily the discussion requires excursions into the management and technical environmental literature. However, we view the juxtaposition of these aspects of risk management as central to providing a well-round examination of the prior art in the current context of its application within the sector.

## **B. Risk analysis and decision-making**

Before entering a discussion on risk analysis, we must be clear in our terminology. In simple terms, risk is widely accepted to consist of a combination of probabilities and consequences. However, further clarity is required. Adapting Hrudey's<sup>68</sup> elaboration, we consider the notion of risk to be a prediction or expectation that involves:

- an agent with the potential to cause either harm and/or benefit (*e.g.* a chemical contaminant, or an investment opportunity);
- uncertainty of occurrence and outcomes (expressed by the probability or likelihood of occurrence);
- consequences (the possible outcomes);
- a specified time frame.

The exploration of these facets provides us with an analysis of risk (note that the authors consider the terms risk assessment and risk analysis to be interchangeable).

Risk is inextricably linked to uncertainty. Thus uncertainty analysis plays a prominent role in many risk analysis strategies. Finally, and in a distinct business context, we consider risk management as the sum of the constituent sets of socio-technical decisions and actions taken by staff to optimise their organisation's exposure to risk.

1 Risk analysis plays a role alongside other decision tools for risk management.<sup>121</sup>  
2 Detailed risk analysis is not a prerequisite for effective risk management. In many  
3 industries there are accepted standards of performance and codes of practice (*e.g.*  
4 engineering standards; accepted best practice; Figure 1) that, if adhered to, provide  
5 high degrees of control. These are applied in familiar and well-characterised  
6 situations where uncertainties and system vulnerabilities are well understood.  
7 However, complex, uncertain and novel systems, that deviate from routine operation,  
8 may require risk analysis, so as to better understand what drives the risk from or to the  
9 plant, process or operation, thereby allowing management measures for the reduction  
10 of unacceptable risks to be targeted for greatest effect.<sup>121</sup> This principle extends  
11 beyond the operation of technical systems to embrace all aspects of managing a  
12 business. This said, risk analysis is, in many respects, a practitioner-driven discipline.  
13 Its application within water utilities has its roots firmly in the protection of public  
14 health from pathogens afforded by the multiple barrier approach to raw water  
15 treatment. Whilst the extension of risk analysis to asset management, water supply  
16 security and catchment (watershed) management is clearly evident, these applications  
17 and the use of risk-based techniques for optimising treatment plant performance, on-  
18 site energy use, maintenance programmes and compliance monitoring regimes can  
19 inadvertently but easily detract from and confuse the principal purpose of the water  
20 supply industry – to provide wholesome, affordable and safe drinking water that has  
21 the trust of customers. In all these applications this goal must remain paramount.

22

23

## 24 **C. The risk hierarchy**

25

1           The organisational hierarchy that exists even within ‘flat’ organisations requires  
2   that risks are actively managed at the strategic, programme and operational levels of  
3   an organisation (Figure 2). Typically, there are split accountabilities for these risks  
4   such that the chief financial officer / financial director and Board have overall  
5   responsibility, supported by an internal audit or control function for the management  
6   of strategic risks; executive and senior management address programme level risks  
7   (*e.g.* asset management, maintenance planning); and operational (*e.g.* site) managers  
8   bear responsibility for operational risks (*e.g.* treatment plant performance).<sup>121</sup> A range  
9   of strategies exist for assessing and managing these risks in a business context. The  
10   focus in this review is sector-specific, addressing ‘process’ risk analysis (*i.e.* risks at  
11   the operational and programme level), but in establishing a business-wide context for  
12   this activity we also draw upon the experiences of organisations assessing risk at the  
13   strategic level.

## 16   **2. STRATEGIC RISK ANALYSIS**

18           Within an overarching context of public health protection and the maintenance  
19   of process reliability, utility managers are increasingly concerned with managing the  
20   risks inherent to corporate level decision-making. Critical issues include decisions on  
21   outsourcing asset maintenance, billing and monitoring, the management of change,  
22   staff retention, the long-term viability of investment decisions, and the management of  
23   external interfaces with regulators and ‘competing’ utilities. Risk analysis tools are  
24   available to inform decisions on these issues (Table 1).

### 26   **A. Regulatory risk**

1           Throughout the 20<sup>th</sup> Century, the central role of water quality to the protection  
2   and preservation of public health encouraged governments to manage utilities within  
3   the public sector.<sup>138</sup> Regulation was historically self-imposed and limited in scope,  
4   and, by extension, posed relatively low risk to municipalities and utilities (in terms of  
5   both the likelihood of non-compliance and the associated penalties). In contrast, more  
6   recent (since the 1980s) regulatory pressures and drives to impose market discipline  
7   on the sector, whether directly (privatisation) or by proxy (*e.g.* corporitisation or  
8   required self-sufficiency), have externalised and broadened the role of regulatory  
9   scrutiny and intervention. Here our discussion is largely restricted to economic  
10  regulation.

11           A concept of regulatory risk is difficult to grasp. Parker<sup>114,115</sup> contends that it  
12  arises from the nature of the regulatory rules and practices, with rules determining the  
13  extent to which interventions are discretionary, and practices relating to the  
14  interpretation the regulators and others (particularly government) place on the rules.  
15  Kilpatrick and Lapsey<sup>75</sup> consider regulatory risk as the uncertain impact of regulatory  
16  decisions on regulated companies. Regulatory risk may best be considered as a  
17  combination of the above interpretations, encompassing both the uncertainty of the  
18  decision-making process and of its impact on utilities.

19           The core issues of regulatory risk are: regulatory independence; regulatory  
20  discretion; transparency and accountability. Independence is critical to minimising  
21  the risk of political interference in a regulatory regime. For example, in England and  
22  Wales, the economic regulator (the Office of Water Services; Ofwat), acting in the  
23  public interest, is vested with a high degree of autonomy from central government,  
24  ensuring that the regulatory process is not subject to direct political interference. In  
25  contrast, in South Australia (SA), the state government directly controls the tariff  
26  setting process, and as the dividend from SA Water is a significant contributor to the

1 state budget, there is the danger that political considerations, as well as commercial  
2 ones, might be perceived to influence regulatory pricing.<sup>7</sup>

3 Regulatory discretion refers to the freedom afforded to regulators to interpret  
4 the importance of set duties and objectives and to determine how best to accomplish  
5 them.<sup>114,75</sup> In the UK, Ofwat's Director General is free to identify and change the  
6 importance attached to set objectives within the regulatory system, within broadly  
7 defined constraints.<sup>114</sup> Arguably, the greater the discretion afforded to the regulator,  
8 the greater the uncertainty related to future regulatory decisions. Ofwat's regulatory  
9 practices are characterised by high levels of transparency and accountability. In  
10 practice, utilities are fully engaged in regulatory decision-making, with avenues for  
11 consultation and appeal established should companies wish to challenge the outcome.  
12 Similarly, the New Jersey Board of Public Utilities, which regulates all investor-  
13 owned utilities in the State, publishes reports on its activities and is transparent and  
14 accountable in its decisions and processes.<sup>7</sup> These arrangements compare to the  
15 German system. Water and sewerage in Germany is the responsibility of the  
16 municipalities and the municipalities regulate and manage the water supply based on  
17 European, national, state and municipal legislation. Though many are satisfied with  
18 these relationships, there has been criticism in a recent report,<sup>7</sup> where regulatory  
19 decisions were viewed as being taken in a closed fashion with little clear  
20 accountability.

21 The nature of a regulatory system (*i.e.* its objectives and the systems in place for  
22 their achievement) represents a core strategic risk for water utilities. For example, in  
23 many developing countries, regulatory scrutiny is largely confined to ensuring a safe,  
24 secure water supply,<sup>7</sup> which, whilst introducing inherent operational risks, does not  
25 invoke strategic uncertainty. In contrast, main goal of Ofwat is to facilitate

1 competition within the sector, an objective that introduces utilities to a range of  
2 hitherto unknown risks.

3 Quantitative treatments of regulatory risk within the literature are restricted to  
4 *ex-post* analyses of the relationship between utility share price volatility and the  
5 regulatory process. Buckland and Fraser<sup>19</sup> modelled variations in the systemic  
6 (market) risk, using a variable  $\beta$  (which measures the variability in returns of a stock  
7 relative to the variability of the broader market), of UK water utilities over time,  
8 examining the extent to which observed variations were associated with the regulatory  
9 process. A key finding was the surge in the market's assessment of the systemic risk  
10 to the industry accompanying the 'surprise' result of the 1992 general election. The  
11 authors' analysis illustrates the influence of politics in even the most independent of  
12 regulatory systems. Similarly, Morana and Sawkins<sup>98</sup> modelled the London stock  
13 market's response to the 1994 'periodic review' of water price setting in the England  
14 and Wales utility sector, finding a significant reduction in share price volatility, which  
15 they postulated to be a reflection of shareholder confidence in the credibility and  
16 sustainability of the settlement.

17 Ideally, for the active management of regulatory risk, analyses should extend to  
18 *ex-ante* treatments of risk. This is of particular relevance to the modern water utility  
19 sector, where widespread structural reforms are requiring utilities to operate under  
20 rapidly evolving regulatory systems – creating unprecedented uncertainty. In such a  
21 market, there has been no historical evolution and the participants, including the  
22 regulatory institutions, have a limited understanding of how it will operate in the short  
23 term and evolve in the future.<sup>78</sup> In such situations, analytical models may offer value  
24 in alerting utilities to unintended consequences of their actions that may trigger the  
25 regulator into reaction.<sup>78</sup> Larsen and Bunn<sup>78</sup> argue that system dynamics, which  
26 incorporates systems thinking into simulation modelling, is conducive to the dynamic,

1 uncertain and subjective nature of assumptions inherent to strategic analysis. To  
2 illustrate, Bunn *et al.*<sup>20</sup> developed a system dynamics model to simulate regulatory  
3 problems in the restructured UK gas and electricity markets. Following problem  
4 definition and hypothesis formulation, the authors constructed a simulation model  
5 describing the main feedbacks involved in the exercise of ‘latent’ market power.  
6 Their analysis explored the relationship between corporate strategies designed to  
7 exercise this power and the risk of regulatory scrutiny. The authors concluded that  
8 market mechanisms were open to exploitation. Such analysis, and assessments of  
9 system sensitivity, could provide utility managers with *a priori* insights into  
10 opportunities for exploiting market ‘imperfections’, thus aiding the development of  
11 corporate strategies.

12

13

## 14 **B. Competition risks**

15

### 16 *Comparative competition*

17

18 On account of the water industry’s inherent monopolistic nature, many  
19 governments and their regulators have sought to expand the role of sectoral  
20 competition. None more prominently perhaps than in the UK, where the concept of  
21 comparative competition underpins the regulatory regime.<sup>137,135</sup> The theory of  
22 comparative, or ‘yardstick competition’ may be traced to the work of Shleifer,<sup>143</sup> who  
23 proposed a regime in which the price (or financial rewards) received by a regulated  
24 firm depends not on its costs (as in traditional ‘cost-of-service’ or ‘rate-of-return’  
25 regulation), but rather on the costs of ‘identical’ firms operating within the same  
26 sector. Shleifer reasoned that by breaking the dependence between the price a firm

1 received and its own costs, and ensuring that the rewards for a given firm depended  
2 on its standing *vis-à-vis* a ‘shadow firm’ (a weighted average of other firms operating  
3 within the sector – an idealised benchmark), each firm would be forced to ‘compete’  
4 with its shadow, providing incentives for cost efficiency (widely perceived as lacking  
5 from rate of return regulation). In practice, the inherent risks of this ‘competition by  
6 proxy’ pale in comparison to those found in fully liberalised markets because market  
7 share is not directly threatened.

8 Techniques for evaluating the ‘explicit’ risks posed by competitors have been  
9 well developed in the business and economic literature. A notable example is  
10 competitor analysis, with its potential to reduce the uncertainty of the price review  
11 process (as price setting is linked to competitor performance). Its application is  
12 helped by the tendency for regulatory bodies to disclose company performance data in  
13 the interests of transparency. In addition to reducing uncertainty, competitor analysis  
14 represents a strategic tool which assists managers in: evaluating competitors’  
15 strengths and weaknesses; identifying sources of competitive advantage; and  
16 assessing the implications of competitors’ strategies on both the sector and their own  
17 utility.<sup>38,133</sup>

### 19 *Capital market competition*

21 As Cowan<sup>27</sup> contends, competition in the capital market can be thought of as a  
22 private-sector version of yardstick regulation, in that it derives from the ability of  
23 investors to make comparisons between different companies in the same sector.  
24 Littlechild,<sup>85</sup> in his report to the UK Department of the Environment on the prospects  
25 for water privatisation, emphasised that this would be an important incentive  
26 mechanism for utilities, as inefficient firms would be reflected in their share price and

1 be vulnerable to take-over, in addition to facing higher costs of capital. Although  
2 Ofwat's restrictions on mergers within the UK water sector, in the interests of  
3 maintaining sufficient comparators, act as a constraint on capital market  
4 competition,<sup>27</sup> the growing internationalisation of the industry increases the risk of  
5 'external' mergers, whilst firms looking to diversify remain a threat to existing  
6 utilities.

7 Furthermore, the quality and quantity of comparative information available  
8 under the 'yardstick' system assists predators in identifying and assessing potential  
9 take-over targets.<sup>136</sup> Singh and Harianto,<sup>145</sup> in reviewing the acquisition literature,  
10 surmised that profitability, size, leverage, and dividends were negatively correlated  
11 with the risk of being acquired. In contrast, profitability and liquidity were positively  
12 correlated with the probability of a firm acquiring, with leverage and dividends  
13 negatively so. In light of this information, the dynamic risk of take-over can be  
14 tracked both in real-time (*e.g.* with respect to the transfer of, for example, more than  
15 5% of firm stocks to a potential acquirer and, in the US, the filing of 13D statements  
16 indicating investor intent) and pro-actively (by 'screening' the external environment  
17 for trends and potential hostile bodies). Of further interest to corporate strategists,  
18 recent research by Dickerson *et al.*<sup>35</sup> suggests that acquisition can be used as a  
19 strategy to reduce the risk of take-over. The researchers concluded this strategy  
20 allows firms to grow quickly, thus protecting them from subsequent take-over. For  
21 utilities considering expansion or diversification strategies, take-over represents not  
22 just a threat but also an opportunity.

23  
24 *Competition for the market*

1 Another means of fostering competition is to encourage the private sector  
2 (perhaps along with the incumbent public utility) to bid competitively for a  
3 concession, lease, tender, or management contract.<sup>27</sup> The two key vehicles for doing  
4 so are franchising and, more conservatively, contracting out (not involving the  
5 transfer of assets). Numerous variants of these processes are adopted internationally,  
6 including: build, operate and transfer (BOT) arrangements; finance, operate and own  
7 (concession); and operate and provide working capital (*affermage*). The inherent  
8 complexity of many of these arrangements, the generally low equity in the project  
9 vehicle,<sup>55</sup> and the often significant investment obligations required of the sponsor,  
10 create a pressing need for comprehensive risk assessment.

11 The project and financial risks associated with public-private partnerships have  
12 been reviewed by Grimsey and Lewis.<sup>55</sup> Using the financing of Stirling Water, a  
13 Scottish design-build-operate contractor as an illustrative example, they discuss the  
14 complexity of the contractual arrangements within such partnerships and use a  
15 quantitative analysis of returns on investment to characterise the robustness of cash  
16 flows from each of the senior lenders to this joint public-private venture. From the  
17 procurer's perspective, project risks (*e.g.* delays and claims) are valued and  
18 incorporated within the NPV calculation, whilst the impact of financial risks (inflation  
19 and interest rate changes) are evaluated through sensitivity analysis. From the  
20 sponsor's perspective, risk analysis centres on simulating the effect of the underlying  
21 variables (*e.g.* operating performance) upon the equity return. Ranasinghe<sup>128</sup> uses  
22 water supply projects in Sri Lanka to outline a methodology based on financial risk  
23 analysis that a government or public utility can use to assess the viability of private  
24 sector participation in new infrastructure projects. The author links a commercially  
25 available simulation package to the financial model to analyse the uncertainty  
26 associated with the underlying variables (*e.g.* escalation in cost).

## *Product market competition*

The traditional approach to introducing direct product market competition into utility services has been to separate the monopolistic component of the industry and regulate it, and to encourage competition in all other areas, *e.g.* the UK model of separating the gas, electricity and railway networks (monopolistic) from the supply of services over the network.<sup>27</sup> This so-called ‘vertical disaggregation’, although promoted by the World Bank,<sup>172</sup> has not been widely adopted in the water sector, the implicit assumption being that the industry is naturally monopolistic.<sup>27,138</sup> The UK has led the way in adopting alternative approaches to facilitate product market competition. This can be traced back to the 1991 Water Industry Act, which introduced the concept of ‘Inset’ appointments, whereby a utility can apply for an appointment to provide water to a ‘large’ customer located within the statutory area of an existing company, usually by seeking a bulk supply from the incumbent.<sup>65</sup> Sawkins<sup>136</sup> reports that the first Inset appointment was granted in May 1997, when Anglian replaced Essex and Suffolk Water (ESW) as the supplier to Buxted Chickens Ltd. Company licences were altered and a new pipe constructed linking the site with an Anglian water main.

In practice, various restrictions, recently eased, have meant that this form of competition has been slow to develop.<sup>136</sup> Similarly, although the 1992 Competition and Service Act allows for cross-border competition, the costs are prohibitive in the majority of cases. Perhaps the most significant recent development has been the introduction of the 1998 Competition Act, which created the possibility for common carriage agreements, or network sharing, in the water industry. Here, the shared use of an incumbent’s infrastructure by a third party enables the latter to provide services

1 within the incumbent's area. To aid this, Ofwat now requires that all water utilities  
2 publish 'Access Codes' that set out their terms and conditions for common carriage,  
3 and has published guidance on this procedure.<sup>110</sup> Hern<sup>65</sup> reports that under the Act,  
4 utilities risk infringement if they refuse access to any parts of their infrastructure  
5 deemed 'essential' without objective justification, or if their access terms are  
6 considered unreasonable. Although no successful applications for common carriage  
7 have resulted to date, the threat alone acts as a catalyst for performance  
8 improvements.

9 The authors were unable to uncover literature quantitatively addressing the risks  
10 of product market competition within the water utility sector, a reflection of its  
11 nascent development and descriptive nature. It seems appropriate here, however, to  
12 introduce an oft-neglected truism: quantitative risk analysis is not a prerequisite of  
13 effective risk management. This is apt in addressing the threats introduced by  
14 product-market competition, where competitor identification and analysis, in concert  
15 with a critical appraisal of self-performance and room for improvement, often provide  
16 an appropriate foundation for minimising competitive threats. In contrast, harnessing  
17 the opportunities presented by product-market competition requires more detailed  
18 analysis, and in the absence of a relevant body of literature, the authors suggest  
19 treating what are effectively, at least in the UK model, potential acquisitions of  
20 company operations in the manner of strategic investment decisions.

### 21 22 **C. Business process re-engineering risks**

23  
24 Our discussion thus far has focused on the strategic approaches to risk  
25 management within the sector. The pressures described are having important impacts  
26 on the performance of the water sector. Structural changes to utility markets, an

1 increasingly demanding political and consumer environment, and more stringent  
2 regulation are requiring utilities to improve financial and operational efficiencies. As  
3 Westerhoff<sup>166</sup> notes, water utilities are responding by rethinking their operations,  
4 finding new ways to address problems, and revamping traditional business models –  
5 in other words, re-engineering. According to Clemons,<sup>23</sup> major business process re-  
6 engineering (BPR) initiatives – which range from the redesign of existing processes  
7 for efficiency improvements, to the development of novel processes in support of a  
8 new corporate vision – require the commitment of substantial resources and often  
9 constitute a lasting legacy. If we define the risk of a project as the deviation in results  
10 from the established goals, then there is substantial empirical evidence marking BPR  
11 as a high risk endeavour. Many, if not most re-engineering efforts ultimately ‘fail’  
12 (see Crowe *et al.*,<sup>28</sup> Remenyi and Heafield<sup>130</sup>). Of particular relevance is the work of  
13 Dean *et al.*,<sup>31</sup> whose analysis of change programmes undertaken in the UK water  
14 industry suggests that re-engineering efforts, whilst often effective, produce highly  
15 variable outcomes. On account of this, project risk analysis should be an integral part  
16 of any re-engineering effort.

17 Clemons<sup>23</sup> considers the core determinants of the risk profiles associated with  
18 large scale BPR efforts to be: (a) functionality risk – the risk of making inadequate or  
19 incorrect changes to systems or processes; and (b) political risk – the risk that the  
20 organisation will not complete the project, either because of significant internal  
21 resistance to the proposed changes or due to a more gradual loss of will. Clemons  
22 promotes scenario planning – a strategic planning tool that embraces uncertainty – as  
23 a means for assessing and subsequently managing the risks associated with re-  
24 engineering efforts. Rather than determining a single ‘correct’ view of the future with  
25 its implicit single response, scenario planning acknowledges the key sources of  
26 uncertainty and incorporates these in developing a range of future scenarios and

1 strategic responses for exploration. Clemons argues that its use is suited to the  
2 context of re-engineering efforts as it encourages the critical examination of potential  
3 futures and strategies, reduces functionality risk and helps ensure the need for change  
4 is internally addressed and accepted, thus reducing political risk. Scenario planning  
5 has been embraced by the majority of UK water utilities.<sup>120</sup> A 2001 study<sup>120</sup> explicitly  
6 linked the tool's use with improved financial performance on the part of utilities,  
7 although notably the authors suggest that scenario planning may implicitly encourage  
8 firms to focus on financial returns at the expense of customer service levels.

9       Recent work by Crowe *et al.*<sup>28</sup> has led to the development of a semi-quantitative  
10 tool for estimating the 'risk of failure' of companies about to undertake re-engineering  
11 efforts. The tool, developed through a survey of BRP-experienced organisations, is  
12 based on measures of the core success (*e.g.* egalitarian leadership; collaborative  
13 working environment; top management commitment; and change management  
14 systems) and failure (middle management fear of losing authority; fear of job loss;  
15 scepticism; discomfort of new working environment) factors of implementing change.  
16 Raw data is extracted by questionnaire (*e.g.* "do managers usually share vision and  
17 information with their subordinates") is used to mine information on the general  
18 leadership style), and refined *via* fuzzy mathematics. Crowe *et al.*'s model is intended  
19 to provide companies with an estimate of the likelihood of success or failure of  
20 proposed efforts prior to committing resources and to improve management's *a priori*  
21 insights into the potential outcomes of re-engineering. Similarly, Remenyi and  
22 Heafield<sup>130</sup> outline a methodology for evaluating the key risk issues relating to re-  
23 engineering efforts. The methodology centres on a risk matrix (Table 2) that groups a  
24 variety of potential BPR risks under the categories of business risk, financial risk,  
25 corporate structure, corporate culture, technology and human. Organisations identify,  
26 weight and rank what they consider to be the ten factors most pertinent to their

1 proposed re-engineering efforts. The framework represents a succinct method for  
2 appraising and comparing the risks associated with BPR strategies. A perceived  
3 failure of much of the BPR literature is the limited emphasis placed on the risks  
4 introduced by adopting new technologies, an aspect critical to many re-engineering  
5 efforts.

### 7 *Technological risk*

9 Clark *et al.*<sup>22</sup> report that technology adoption is increasingly becoming a  
10 concern of strategic planners and policy makers within the water industry. The  
11 introduction of novel technology poses risks due to the inherent difficulty of preparing  
12 accurate estimates of the costs, performance and system-wide effects of new  
13 components and processes; and the long development cycles required for changes in  
14 regulations and consumer demands.<sup>26</sup> This has led many researchers to advocate the  
15 incorporation of risk management techniques for the effective implementation of new  
16 technologies (*e.g.* Colmer *et al.*<sup>26</sup>; Fitzpatrick<sup>47</sup>). This is highly relevant to the water  
17 sector, where, as Maxwell<sup>91</sup> notes, the advance of modern technology is illustrated by  
18 such trends as the replacement of traditional methods of water treatment with  
19 advanced oxidation and other novel physical and mechanical technologies; the broad  
20 use of membrane systems to desalinise seawater for human consumption; and the  
21 increasingly widespread use of recycling systems and technologies.

22 McGaughey *et al.*<sup>92</sup> describe a framework for viewing and comparing the risks  
23 inherent in the adoption of new technologies, specifically relating to IT. Initially,  
24 proposed projects are assessed, through value chain analysis, in terms of their  
25 potential positive and negative outcomes – these are then mapped onto a ‘speculative’  
26 risk matrix to provide management with an initial screening of alternatives. In later

1 stages of planning, specific threats and opportunities associated with the project are  
2 identified and ranked, by likelihood and consequence, for prioritisation purposes.  
3 Hartmann and Lakatos<sup>62</sup> drew on case studies monitoring the pace and quality of  
4 technology delivery within two product development programmes and generated an  
5 algorithm characterising the risk of each technology problem (Figure 3). The authors  
6 suggest that its use can aid in the refinement of technology development and  
7 implementation plans following risk identification. Hartmann and Lakatos define  
8 technology problems as those arising:

- 9
- 10 • from the application of a new process, material or subsystem before fully
- 11 understanding parameters that control cost, latitudes and failure modes;
- 12 • when a previously commercialised technology is extended outside the
- 13 known domains of the pertinent design rules; and
- 14 • from unexpected interactions arising from a new or unique combination of
- 15 known subsystems of components.
- 16

17 Of further interest, the authors<sup>62</sup> developed a checklist to help technology and  
18 product developers audit technology progress, which we have adapted to serve as a  
19 tool for minimising the risk associated with introducing new technologies (*i.e.* beyond  
20 the development stage):

- 21
- 22 • Implementation goals confirmed
- 23 - validate business assumptions and technology specifications for cost,
- 24 performance and reliability
- 25 • Technology mastery demonstrated
- 26 - critical parameters identified

- 1                   - failure modes identified
- 2                   - set risk tolerances relating to the critical parameters so as to avoid
- 3                   failure modes and deliver the required performance
- 4                   - performance demonstrated using a combination of hardware and
- 5                   mathematical simulation
- 6                   - manufacturing feasibility established
- 7               • System specifications re-established
- 8                   - system and subsystem financial and operational performance targets
- 9                   are re-established and re-assessed based on technology specifications
- 10               • Additional assessments completed
- 11                   - supporting assessments completed, such as safety and environmental
- 12                   impact study
- 13               • Contingency planning
- 14                   - develop contingency plans should critical risks materialise in spite of
- 15                   control procedures in place

16

17               Wildemann<sup>170</sup> describes a framework for guiding technology planning. Risk

18   profiles are constructed displaying the relative importance of identified threats and

19   opportunities, and thus the inherent ‘attractiveness’ of the technology, complemented

20   by a strengths-weaknesses analysis that estimates the ability of the firm to

21   successfully implement the technology. The author’s aim was to provide an analytical

22   basis upon which strategies may be developed for the introduction of new

23   technologies.

24

25

## **D. Outsourcing risks**

Our discussion of risk analysis strategies moves to one of the key features of the international water business – outsourcing. A significant feature of water utility management in recent years has been the growth in outsourcing, defined as the transfer of previously in house activities to a third party. Outsourcing allows utilities to focus on critical functions (core business), access economies of scale, minimise investment, increase quality of service, transfer risk, and reduce administrative burdens including regulatory compliance.<sup>116,42,36</sup> Common candidates for outsourcing include information technology, maintenance, distribution, manufacturing, and customer care and billing.<sup>116</sup> A widely held view is that the potential for outsourcing is far from exhausted. A holistic approach to risk being promoted in this review requires that in addition to the traditional review of legal and regulatory responsibilities following contractual agreement, the process of outsourcing should fall within the remit of corporate risk management. That is, outsourcing alters the boundaries of the firm, and the scope of risk analysis and risk management programmes should be extended to reflect this.

Risks are inherent in the process of outsourcing, from the decision to outsource, to the management of agreed contracts. Received wisdom has been that companies should focus on ‘core competencies’ and outsource the remaining parts of the business (although the validity of this distinction has been questioned of late, notably by Heikkilä and Cordon<sup>63</sup>). The core risks discussed in the literature relating to decisions over what to outsource and who to outsource to include: the loss of key capabilities, developing dependence on the vendor, and risks linked to the service provider’s deficient capabilities. Each decision to outsource must be carefully assessed from a risks and benefits perspective.<sup>36</sup> Decision-making frameworks are

1 available for this purpose. Lonsdale's<sup>86</sup> decision tree for outsourcing provides a  
2 framework for evaluating what constitutes an organisation's core competencies, and  
3 analysing market opportunities for outsourcing the remaining parts of the business.  
4 The framework seeks to ensure managers retain those resources responsible for  
5 competitive advantage, avoid monopolistic or oligopolistic supply markets, and  
6 effectively manage the risk of post-contractual dependency. A similar model,  
7 although focussed at the policy level, is provided by Quélin and Duhamel.<sup>125</sup> Of  
8 course, successful outsourcing further depends on managing supply risks, defined as  
9 the transpiration of failures with in-bound goods and services.<sup>176</sup> Core categories of  
10 supply risk discussed in the literature include: the financial stability of the supplier;  
11 cost fluctuations; capacity constraints of the market and specific suppliers; variations  
12 in quality; the ability of the supplier to adapt to required changes in design or  
13 technology; and natural disasters. Two diametrically opposed approaches to  
14 managing supply risk are the active management of risk interfaces with the intention  
15 of reducing vendor failures,<sup>176</sup> and the construction of barriers (*e.g.* safety stock,  
16 multiple sources) to buffer the effects of inherent uncertainties.<sup>46,104</sup> Tools in support  
17 of the former approach include qualitative assessments of the financial stability of  
18 potential suppliers; formal models for the demonstration of supplier capacity  
19 performance; 'what-if' scenario planning; and statistical process control to detect  
20 deviations from desired quality.<sup>176</sup>

21

22

## 23 **E. Employee retention**

24

25 Retaining valued employees has long been an implicit component of good  
26 utility management. The recent emphasis on people as *the* resource, along with the

external realities of an increasingly dynamic and pressurised labour market, have led to the sector embracing employee retention as a critical risk issue – particularly in the technically specialised areas of the water business. This focus is exemplified in recent sectoral research initiatives (e.g. American Water Works Association Research Foundation (AwwaRF) project #2850 ‘Succession planning for a vital workforce in the information age’), and a recent (2001) policy statement from AWWA calling on utilities to establish formal employee retention plans.

Maintaining employee retention, thus managing the risk of losing organisation capacity, begins at the recruitment stage (e.g. Barney,<sup>9</sup> McNally,<sup>94</sup> Denton<sup>33</sup>). Empirical evidence suggests that ensuring a ‘cultural match’ between employees and the organisation plays a critical role in reducing staff turnover.<sup>141</sup> The tool applied by Sheridan<sup>141</sup> to ‘measure’ culture (beliefs and values) was the Organisational Culture Profile (OCP) instrument developed by O’Reilly *et al.*<sup>109</sup> The OCP assesses candidates by encouraging them to sort value statements on: norms regarding the completion of work tasks; norms regarding interpersonal relationships; and norms regarding individual actions. Utilising the OCP as a part of the recruitment process could provide utilities with a proactive tool for minimising staff turnover, by filtering those most likely to leave the organisation early from the selection process. Additionally, it enables the risk-based targeting of retention efforts, for example by focusing efforts on employees hired regardless of ‘cultural misfit’.

This philosophy is mirrored in the work of McNally,<sup>94</sup> who promotes the use of more traditional tools such as personality assessments at the recruitment stage to ensure ‘good fits’ of personality and work ethic. As Denton<sup>33</sup> notes, whilst “*good recruitment is certainly important, it is what happens to recruits after joining an organisation that determines whether a company will retain them.*” In relation to this, McNally<sup>94</sup> encourages organisations to develop ‘early warning systems’ to

1 identify employees at risk of leaving. Such a system requires the collection and  
2 analysis of retention data by subgroup (*e.g.* ethnicity, gender, function, organisational  
3 level, *etc.*) to facilitate identification of ‘at-risk’ groups. Following identification,  
4 tools such as employee surveys, employee reviews, mentor or manager feedback,  
5 local economic trends, head-hunter activity, and, crucially, the exit interview may be  
6 used to determine factors driving high rates of defection.<sup>94</sup> Adherence to such a  
7 system would provide utilities with comprehensive data on who is leaving and why,  
8 providing the foundation for developing effective, tailored retention strategies. A  
9 recurrent theme of the retention literature is that incentives (*e.g.* salaries and benefits)  
10 alone are not enough for achieving high levels of retention, the contention being that  
11 retention is related more closely to employee development and intrinsic benefits such  
12 as working relationships, job satisfaction and a sense of empowerment (*e.g.*  
13 Hagevik;<sup>60</sup> McNally;<sup>94</sup> Thompson;<sup>158</sup> Denton<sup>33</sup>). Accordingly, utilities may consider  
14 undertaking a gap analysis of their employee development schemes (interestingly,  
15 Brueck<sup>18</sup> reports that water utilities spend as little as 1% or less of their labour budget  
16 on nonmandatory employee training) and benefit programmes before remedying  
17 deficiencies in order to minimise turnover rates. An alternative approach to  
18 identifying the level of retention risk is to undertake an informal risk assessment<sup>4</sup>  
19 which is essentially a checklist addressing the core issues influencing turnover (*e.g.*  
20 employee-manager relationships, communication, job satisfaction, *etc.*).

21 The negative consequences of employee turnover are clearly emphasised  
22 throughout the literature, leading to the implicit assumption that organisations should  
23 ‘pull out all the stops’ to minimise defection rates. However, as Sigler<sup>144</sup> and  
24 Mowday<sup>100</sup> contend, the costs of reducing retention may, in some cases, exceed the  
25 benefits to be derived. It is thus incumbent on organisations to critically analyse the

costs and benefits of implementing retention strategies; the cost-benefit analysis approach offers a promising framework for this purpose.

#### **F. Assessing investment risks**

Behind each strategic investment an organisation considers lies some calculation of the move's worth.<sup>87</sup> Following Rothstein and Kiyosaki,<sup>134</sup> we define strategic investments as those resource allocations that will yield substantial advances toward the achievement of a utility's strategic goals. Whether considering a joint venture, acquisition, or a major extension of an existing facility, how the utility estimates value is a critical determinant of how it allocates its resources, which is in turn a key driver of its overall performance.<sup>87</sup> Valuation methodologies range from the formal (comprising an appraisal model and a supporting theory) to the informal (based on heuristics).<sup>87</sup> However, since the 1970s there has been a trend towards applying valuation methods that are more formal, explicit, and institutionalised.<sup>87</sup> The most widely adopted framework is the Net Present Value (NPV) model, which estimates value by capitalising (discounting) future streams of cash flow that the investor expects to receive from an asset. The capitalisation rate is the minimum expected rate of return needed to induce an investor to acquire. Capitalisation is comprised of two components, the risk-free rate of return (accounting for the time value of money) and the risk premium (the additional compensation demanded by investors for assuming risk). Although issues have been raised regarding the applicability of conventional appraisal methodologies to the water industry, specifically relating to the long lifespans of many capital projects and the fact that they often do not generate revenues in the traditional sense (*e.g.* Tebbutt *et al.*<sup>155</sup>), they remain favoured by academics and industrialists. Our subsequent discussion

1 focuses on three distinct investment problems: valuation of assets-in-place; valuation  
2 of ‘opportunities’; and the valuation of joint ventures.

#### 4 *Assets-in-place*

6 The most basic valuation problem is valuing assets-in-place, *i.e.* the valuation of  
7 an ongoing business or some part of one, for the purposes of informing decisions  
8 ranging from a change in suppliers to an acquisition.<sup>87</sup> It is for such situations that  
9 Discounted Cash Flow (DCF) techniques (methodologies for determining the  
10 capitalisation rate) are suited.<sup>87</sup> In brief, the established DCF methodologies include  
11 the weighted-average cost of capital (WACC),<sup>97</sup> the capital asset pricing model  
12 (CAPM)<sup>140</sup> and the adjusted present value (APV).<sup>102</sup> The WACC, which establishes  
13 the risk premium on the basis of the ‘cost of capital’ financing the investment,  
14 remains the most commonly practised approach,<sup>87</sup> though is increasingly criticised in  
15 academic circles (*e.g.* Luehrman,<sup>87</sup> Gregory<sup>54</sup>). The fundamental idea behind CAPM  
16 is to use  $\beta$ , a measure of systemic (market) risk, to adjust cash flows. In contrast,  
17 APV seeks to unbundle the various components of value (*i.e.* cash flows), analyse  
18 them separately, and then add up the present values. For a fuller discussion of these  
19 and other DCF techniques see *e.g.* Modigliani and Miller,<sup>97</sup> Sharpe,<sup>140</sup> Myers,<sup>102</sup> Berry  
20 *et al.*,<sup>12</sup> Gregory,<sup>54</sup> Luehrman,<sup>87</sup> and Ye and Tiong.<sup>173</sup>

21 Regardless of the individual strengths and limitations of the above models, a  
22 common deficiency is that there is no indication of the confidence level on the  
23 determined capitalisation rates.<sup>173</sup> Following on from Hertz,<sup>66</sup> who highlighted the  
24 misleading nature of single-point estimates in investment analysis, most researchers  
25 advocate the appraisal of investments within a non-deterministic framework; the  
26 principle being that investment forecasts are, by definition, uncertain. Reflecting this

1 uncertainty in model outputs lends some assurance to the decision-makers that the  
2 available information has been used with maximum efficiency.<sup>66</sup> This is reflected in  
3 Guidelines published (1999) by the Asian Development Bank<sup>6</sup> on the application of  
4 financial evaluation methodologies to water supply projects. Risk analysis, in the  
5 form of sensitivity analysis and stochastic simulation, is promoted as a means to  
6 examine the influence of changes in key underlying variables on forecast cash flows,  
7 and the probability that project NPV will fall below zero. Incorporating these  
8 principles, Barriex *et al.*<sup>10</sup> describe the application of the NPV framework to the  
9 proposed restructuring, privatisation and optimisation of water utility operations in  
10 Panama. The focus of their study is on the proposed rehabilitation of systems  
11 supplying water to Arraijan, Chorrera, Colon and Panama City, a ‘holistic’  
12 programme entailing the upgrading of commercial, technical and operational aspects.  
13 Through stochastic simulation and sensitivity analysis of forecast financial returns, the  
14 authors confirmed the project’s robustness from a financial standpoint, determining a  
15 ‘zero’ probability of negative NPV.

16 Thomas<sup>157</sup> uses an illustrative example to examine the role of CAPM in  
17 adjusting for the risk inherent to acquisition / diversification appraisals (using internal  
18 rate of return (IRR), an appraisal framework similar to NPV). Accounting for the  
19 unique nature of acquisition / diversification appraisals, the author provides a  
20 methodology for integrating expected financial and operational synergies (*e.g.* derived  
21 from financial and operating economies, or the pooling of functional areas) within the  
22 analysis. However, through applying a risk premium to projected cash flows (which  
23 by definition accounts for the increased returns investors demand for variable cash  
24 flows) and undertaking simulation of the variables influencing future cash flows (thus  
25 explicitly modelling the variability of returns), Thomas<sup>157</sup> is effectively ‘double  
26 counting’ for risk, introducing a bias against investment decisions. This criticism is

supported in the work of Burchett and Tummala,<sup>21</sup> who apply Monte Carlo simulation to an NPV based appraisal of an infrastructure capital investment decision. These researchers argue that applying specific probability distributions to the relevant variables captures all potential risks relating to the investment, thus negating the requirement for incorporating a risk premium as part of the capitalisation rate.

Although it is widely accepted that a probabilistic approach to investment risk analysis is desirable, problems exist. As Songer *et al.*<sup>148</sup> assert, the failure to identify all significant risks (*i.e.* to apply appropriate probability distributions to all relevant underlying variables) quickly undermines model validity and output. A further pitfall is identified by Mosca *et al.*,<sup>99</sup> who in applying simulation methodologies to a proposed plant investment, found that the choice of frequency distribution chosen (often arbitrarily) for the independent variables can have a marked effect on the process outcome. These are important observations in that they highlight the biases inherent to all risk models, reminding of us of the need to use risk analysis output diagnostically rather than to over-invest belief in quantitative risk estimates.

In financial circles, recent times have seen an increasing adoption of tools that can perform economic evaluation and modelling on the combined entity of investments (portfolio) as well as for each individual project. This trend extends beyond the financial sphere, as is illustrated in the work of Rothstein and Kiyosaki,<sup>134</sup> who describe the application of portfolio management theory to water utility investment planning. The philosophy of their approach is to create a portfolio representing a balanced array of investments that mitigate uncertainties and that are likely to realise potential returns. Of particular interest is their use of multi-attribute analysis, which allows the risk-based prioritisation of monetary and non-monetary investment decisions within a single analytical framework.

1

## 2 *Opportunities*

3

4       It is relevant here to further discuss the work of Luerhman,<sup>87</sup> who categorises a  
5 second type of valuation problem – the valuation of opportunities (*i.e.* possible future  
6 operations) – as distinct from the valuation of operations (assets-in-place). The  
7 distinction is that with the former, the decision to invest may be deferred. In  
8 opportunity valuation, risk matters in two ways: the risk of the investment, and the  
9 risk that circumstances will change before a decision has to be made – such  
10 contingencies are not well handled by the traditional DCF approach.<sup>87</sup> Luerhman<sup>87</sup>  
11 states that a common approach in the valuation of opportunities is simply not to value  
12 them formally until they mature to the point where a decision can no longer be  
13 deferred, where they can then be valued, in effect, as assets-in-place. Critics have  
14 decried this practice, on the premise that it leads companies to undervalue the future  
15 and hence underinvest.<sup>87</sup> In response, Luerhman<sup>87</sup> discusses the potential of ‘option-  
16 pricing theory’<sup>14</sup> - an analytical strategy that allows managers to handle the  
17 contingencies created by the time-dependant nature of opportunity valuation - as a  
18 supplement, not a replacement, for the valuation method for in place assets.

19

## 20 *Joint-ventures*

21

22       A further category of investment decisions is found where firms participate in  
23 joint ventures, partnerships, or strategic alliances. This takes on particular resonance  
24 in the water industry, where recent years have seen a proliferation in public / private  
25 partnerships. In such cases, where ownership is shared with other parties, managers

1 need to understand both the value of the venture as a whole *and* the value of their  
2 company's interest in it.<sup>87</sup>

3 The investment risks associated with public-private partnerships have been  
4 reviewed by Grimsey and Lewis.<sup>55</sup> Using the financing of Stirling Water, a Scottish  
5 design-build-operate contractor as an illustrative example, apply quantitative analysis  
6 of returns on investment from the perspective of the private (sponsor) and public  
7 (procurer) sector entities.

8 A common observation of the risk management literature is an all too  
9 obvious gap between theory and practice. Much of the highly theorized investment  
10 literature does not reflect standard industry practice, particularly that relating to the  
11 application of complex methodologies such as simulation and scenario analysis. The  
12 discrepancy is explained, in part, in that such techniques do not fit naturally into most  
13 companies' skill sets or capital-budgeting systems.<sup>87</sup> Despite this, there is a dearth of  
14 literature focussing on the practicalities of integrating such tools deep within company  
15 structures. To address this issue and as part of the research that has informed this  
16 review, the authors will be undertaking a benchmarking of risk management  
17 capabilities within the international water utility sector.

### 20 **3. PROGRAMME RISK ANALYSIS**

22 We turn to a more familiar discussion of the application of risk analysis to the  
23 water utility sector. The revised WHO guidelines<sup>167</sup> are promoting the implementation  
24 of water safety plans for water quality management from catchment management,  
25 through process control, distribution and on to the tap.<sup>160</sup> Application of risk analysis  
26 to these aspects of the water 'supply chain' extends to programmes of work as well as

1 individual plant operations. A discussion of the latter, operational risk analysis  
2 follows, but here we are concerned with the analysis of risks associated with  
3 programmes of activity that are ‘rolled-out’ across organisations, such as asset  
4 management and maintenance planning. Here, managers are responsible for the  
5 implementation of strategies across company functions, multiple sites and geographic  
6 regions. They are concerned with: evaluating the risks posed by a similar hazard at a  
7 variety of locations (*e.g.* mains bursts, network intrusion – in asset management, for  
8 example); the risk-based appraisal of operational strategies and long-term planning in  
9 relation to the water supply-demand equilibrium; and the wide variety of risks  
10 existing within a catchment or watershed. Table 3 summarises the portfolio of  
11 analysis techniques available at the programme level.

12

13

#### 14 **A. Asset management**

15

16 In line with Booth and Rogers,<sup>16</sup> we consider asset management as “*managing*  
17 *infrastructure capital assets to optimise the total cost of owning and operating them*  
18 *while delivering the service levels customers desire.*” Managing risk in the face of  
19 limited resources has long been an implicit component of asset management. Within  
20 the UK, pressure from the economic regulator has ensured that the explicit  
21 incorporation of risk analysis into asset management programmes has taken on added  
22 momentum. Water utilities are expected to:

23

24 “*demonstrate how the flow of services to customers can be maintained at least*  
25 *cost in terms of both capital maintenance and operating expenditure, recognising the*

1 *trade off between cost and risk, whilst ensuring compliance with statutory duties’’*  
2 *(Ofwat letter MD 161, April, 2000).*

3

4 In addition to regulatory pressures, the global trend towards requiring financial  
5 self-sufficiency on the part of public and private utilities has created a climate in  
6 which management can no longer seek to ‘over-engineer’ facilities with the  
7 presumption of screening out technical risk. A recent (2004) report<sup>163</sup> to the US  
8 Senate cites “*mounting evidence suggest[ing] that the integrity of the nation’s*  
9 *[water] infrastructure is at risk without a concerted effort to improve the management*  
10 *of key assets...and a significant investment in maintaining, rehabilitating and*  
11 *replacing these assets’’*. The report goes on to explicitly endorse the role of risk  
12 analysis in asset management. More than ever, utilities must now seek to balance  
13 spending with risk minimisation. A risk-based approach to asset management  
14 requires an integrated, systematic process drawing upon a broad range of  
15 methodologies for the identification, analysis and prioritisation of assets-at-risk, from  
16 the process to the component level (*e.g.* Lifton and Smeaton;<sup>82</sup> Booth and Rogers<sup>16</sup>).

17 On a national scale, the US Natural Resources Defence Council (NRDC)<sup>106</sup>  
18 recently (2003) reported on the risk to drinking water quality from ageing pipes and  
19 process plant across the US with individual city ‘rankings’ being informed by water  
20 quality data, USEPA compliance records and water utility annual reports. Many  
21 water companies have in place risk-ranking procedures to evaluate and rank potential  
22 risks across a variety of categories, and thus help inform and prioritise risk  
23 management procedures.<sup>121</sup> For example, Radovanovic and Marlin<sup>126</sup> describe the  
24 risk-based approach to water mains asset management in place at Sydney Water  
25 (Australia). Budgetary requirements are estimated through the application of  
26 KANEW, a statistically based survival model which aids the calculation of pipe

1 rehabilitation and replacement needs for distribution networks. The identification of  
2 specific pipes requiring work is external to the model, with separate approaches for  
3 trunk and reticulation mains (the latter generally being run to failure). Critical trunk  
4 mains are identified by means of a checklist-aided screening approach, wherein  
5 preliminary assessments of failure likelihood and consequence are combined to create  
6 an overall risk score. This combined risk score is used to identify critical water mains  
7 deemed to require more detailed analysis (*e.g.* condition-based assessments). This  
8 methodology allows Sydney Water to identify and prioritise water mains in need of  
9 rehabilitation / renewal, and to proactively assess budgetary requirements.

10         Louisville Water Company (Kentucky) apply their Pipe Evaluation Model,  
11 which integrates data such as pipe age and maintenance history, as a tool for  
12 prioritising pipe and water mains for rehabilitation and replacement.<sup>163</sup> Utility  
13 managers report that this model, in combination with wider asset management  
14 practices, has helped reduce the frequency of water mains breaks from 26 to 22.7 per  
15 hundred miles and the frequency of joint leaks from 8.2 to 5.6 per hundred miles.<sup>163</sup>  
16 Seattle Public Utilities adopt a risk-based approach to asset management, considering  
17 likelihood and impact of pipe rupture with reference to such factors as age, material,  
18 location and historical cost of repair.<sup>163</sup> Drawing upon this analysis, utility officials  
19 were able to delineate their pipe network into areas of critical and non-critical risk,  
20 and allocate maintenance and rehabilitation resources accordingly. Through adopting  
21 this approach, officials believe that they are using staff resources more efficiently and  
22 that, over time, the programme will lead to a reduction in maintenance costs.<sup>163</sup>

23         Kent *et al.*<sup>73</sup> describe how risk analysis informs the prioritisation of investment  
24 strategies for trunk main maintenance at *Dwr Cymru* Welsh Water. The methodology  
25 is based on the available records of asset performance, condition and serviceability,  
26 which are stored on the company's WAM (Water Asset Management) database.

1 STRUMAP, a software-based mapping system, allows clustered failures to be  
2 considered separately from ‘random’ bursts, a task performed as the former are  
3 considered likely to be representative of underlying susceptibilities. For each location  
4 where a cluster is identified, specific failure rates are derived. For random bursts,  
5 failure data is separated according to pipe material and diameter, with failure  
6 likelihood determined by group. STRUMAP further enables consideration of failure  
7 consequences, in terms of the number of properties potentially affected by an event,  
8 taking into account service reservoir storage. Failure likelihood and consequence are  
9 then combined to derive an overall severity score, which in turn informs the  
10 derivation of investment requirements. The National Research Council of Canada are  
11 currently developing a prototype Water Mains Renewal Planner (WARP),<sup>127</sup> which is  
12 aimed at integrating the most promising breakage analysis models into one discrete  
13 decision support tool. At present, WARP consists of three modules: a) analysis of  
14 water main breakage patterns; b) short-term operational forecasting; and c) long-term  
15 renewal planning. A fourth module is to be added to enable prioritisation of  
16 individual water mains for renewal.

17 Foster *et al.*<sup>50</sup> detail a risk-ranking approach for estimating the relative  
18 likelihood of failure of embankment dams by piping. Failure likelihood is assessed by  
19 weighting the historical frequency of piping failure with respect to dam zoning, filters,  
20 dam age, core soil types, compaction, foundation geology, dam performance, and  
21 monitoring and surveillance. The methodology allows the prioritisation of dams-at-  
22 risk for more detailed analysis, and is further offered as a check on traditional event-  
23 tree methods (see also Seker *et al.*<sup>139</sup>).

24 Failure modes and effects analysis (FMEA), developed by the US military, is an  
25 engineering technique that tabulates failure modes of equipment and their effects on a  
26 system<sup>1</sup> (Table 4). The failure mode describes how equipment fails (open, closed, on,

off, leaks, *etc.*). The failure effect is determined by the system's response to the equipment failure. When FMEA is extended by a criticality analysis, it is known as failure modes, effects and criticality analysis (FMECA).

Lifton and Smeaton<sup>82</sup> detail how Scottish Water apply source-to-tap FMECA studies across their water supply systems as part of their 'asset management toolkit'. This allows priority risks to be identified and subsequently compared across the utility portfolio (*e.g.* various mains, raw and treated reservoirs, treatment works *etc.*) in order to focus attention on the most serious threats to system performance. Infrastructure investment strategies are further informed by the HYSIM-AQUATOR supply-demand model. Of particular interest is their description of the asset risk and criticality scoring system implemented at Scottish Water. The system is designed to assess the relative 'total business impact' of asset failures across the company by reference to a 'common currency of risk' (one point equates to £1000 of business impact), facilitating a consistent approach to risk scoring across Scottish Water. Additionally, this scoring system guides the prioritisation of reliability studies at the operational level, which further informs asset management strategy.

Given the complexity inherent in describing modes of structural failure and assessing their likelihoods,<sup>53</sup> logic models (visual risk schematics, *e.g.* reliability block diagrams, fault tree analysis (FTA) and event tree analysis (ETA), see Figures 4 and 5) have found application in support of asset management. Parr and Cullen,<sup>117</sup> through examining the applicability of logic modelling techniques to dam failure analysis, illustrate how such an approach can inform the prioritisation of expenditure on monitoring, maintenance and remedial works. Similarly, Gray and Powell<sup>53</sup> promote the use of logic diagrams in aiding the development of risk-based strategies for maintaining asset security. The authors model the interactions leading to failure for each class of aqueduct structure. To this, historic data, or where data is deficient,

engineering judgement, are applied in order to derive failure probabilities. A cautionary note is sounded by Latiffe,<sup>79</sup> who contends that risk analysis, specifically logic modelling, is not yet effective in modelling dam failure. The author cites insufficient statistical data on the deficiencies of structural components as the core drawback.

### *Spatial context of risk*

Geographic Information System (GIS) technologies now play a critical role in asset management. At its most basic level, GIS allow utilities to convert data ordinarily displayed on paper maps into one single, easily accessible digital format, representing an excellent method for storing and collating data for future use.<sup>49</sup> The level of detail (*i.e.* the layers of spatial data) contained within such systems varies widely. Kaufman and Wurtz<sup>72</sup> describe the evolution of a GIS for a small utility (Beecher Water District, Michigan). An extensive inventory of asset condition records and failure and maintenance data is collated within the system, supporting the risk-based planning of capital improvement and maintenance works. Pertinently, the system took only three months and less than \$3,000 to develop. Similarly, Booth and Rogers<sup>16</sup> illustrate how the implementation of GIS technologies within an asset management decision support system can allow for the visual tracking of infrastructure assets and their associated risk factors.

Although applications of GIS technologies in support of asset management have proven to be powerful risk-tracking, visualisation and communication tools,<sup>16</sup> they rarely utilise the capabilities of GIS to spatially analyse data in the classical sense.<sup>49</sup> Doyle and Grabinski<sup>37</sup> illustrate these capabilities through quantitatively relating Toronto's infrastructure deterioration to spatially variable corrosion risk factors,

1 providing a basis for the identification of network areas most at risk from external  
2 corrosion. Such an approach may allow utility managers to better focus rehabilitation  
3 efforts through having a more complete understanding of the causative factors behind  
4 water main deterioration. Of further interest is the work of Ta,<sup>153</sup> who describes the  
5 application of a probability model for burst risk studies of water mains. Contributing  
6 factors (*e.g.* pipe number density, pipe age, material and diameter, soil corrosivity,  
7 *etc.*) are represented as GIS data layers and correlated with past failure data in order to  
8 deduce burst probability scores for each water main. The tool, developed for Thames  
9 Water Utilities Ltd. (UK), is not intended to predict the likelihood of pipe bursts,  
10 rather to aid utilities in sourcing the origin of an area burst (*i.e.* following a pipe burst  
11 in the area, the value of probability evaluated for a particular pipe section would  
12 indicate the likelihood that the burst actually occurred at that section).

13 While GIS represent powerful tools for spatial data analysis, their inherent  
14 capabilities for complex and dynamic analysis are limited.<sup>152,43</sup> In contrast, traditional  
15 simulation models are powerful tools for complex and dynamic situations, but often  
16 lack the intuitive visualisation and spatial-analysis functions that GIS offers.<sup>152,43</sup>  
17 Consequently, researchers have sought to couple these systems. Lindley and  
18 Buchberger<sup>83</sup> describe the integration of hydraulic modelling within a GIS for the  
19 purpose of assessing intrusion susceptibility in distribution systems. The holistic  
20 methodology enables the synthesis of multiple risk factors describing the three key  
21 (geographically variable) susceptibility conditions of adverse pressure gradient,  
22 intrusion pathway, and contaminant source, thus identifying areas susceptible to  
23 intrusion (accidental or intended). Susceptible locations are then prioritised for  
24 attention by considering how they are hydraulically connected to local sensitive  
25 populations. In addition to informing asset management programmes, this framework  
26 may also be applied in a reliability context at the design stage. Similarly, Besner *et*

1 *al.*<sup>13</sup> illustrate *via* case study how the coupling of a GIS containing structural,  
2 operational and water quality parameters with simulation model EPANET facilitates  
3 the identification of key factors responsible for water degradation in the distribution  
4 network. Through identifying network areas presenting the greatest risk, this  
5 technique can inform the prioritisation of risk management strategies.

## 8 **B. Catchment management**

10 The concept of catchment (or watershed) management has gained widespread  
11 international support, representing a shift from the sole reliance on end-of-pipe  
12 treatment technologies for point sources towards the watershed-specific prioritisation  
13 of water quality problems and their integrated solution.<sup>48</sup> An outcome of this is that  
14 the assessment of hazards to the quality of water resources within a catchment is  
15 increasingly subject to formal risk assessment and can be expected as part of routine  
16 water safety plans.<sup>160,161,167</sup> In Europe, the DPSIR approach to identifying key  
17 hazards within a watershed, by reference to the driving forces (*e.g* population growth),  
18 pressures (sewer discharge), state (increased nutrient load), impacts (anthropogenic  
19 eutrophication) and policy response (discharge control) is being adopted under the  
20 European Water Framework Directive.<sup>70</sup> Here, risk assessments of activities posing a  
21 an actual or potential threat to the quality of water bodies in ‘river basin districts’ are  
22 intended to inform and help prioritise a programme of multi-agency action plans  
23 targeted at raising the overall ecological status of the watershed within statutory  
24 timescales. Given the plethora of potential catchment management issues in any  
25 improvement programme, there is a need to prioritise risk management efforts within  
26 the watershed by concentrating on those measures that reduce the significant

1 likelihood of severe impacts being realised. Southern Water (UK) adopt a semi-  
2 quantitative ranking scheme in screening their groundwater sources for  
3 *Cryptosporidium* contamination risk, as described by Boak and Packman.<sup>15</sup> The  
4 methodology consists of ranking source waters across ten risk categories (*e.g.* land  
5 use) using pre-determined scoring hierarchies (*e.g.* occasional livestock grazing: 2),  
6 before combining these category rankings into an overall weighted risk score.  
7 Through this approach the utility identifies those sources deemed to be at significant  
8 risk of oocyst contamination, and which therefore require continuous monitoring (in  
9 line with regulations).

10         Given the improved capabilities and functionality of modern GIS and their  
11 inherent ability to map and analyse data that is spatially variable in nature, many  
12 catchment-level ranking methodologies have sought to incorporate their benefits.  
13 Various authors<sup>88,146,169,49,111,51</sup> describe the use of map overlay techniques (which  
14 essentially combine the attributes of two or more data layers across geographic space)  
15 in the identification and mapping of areas critical to catchment water quality. These  
16 risk-mapping (essentially spatial risk-ranking) methodologies centre on the analysis of  
17 those spatial attributes considered to play a significant role in pollutant transport (*e.g.*  
18 geology, rainfall, soil type, agricultural activities *etc.*) according to pre-defined  
19 formulae (*e.g.* a weighted runoff-potential index). Their focus may be generic or  
20 targeted towards specific hazards (*e.g.* animal feeding operations) or pollutants (*e.g.*  
21 through incorporating measures of their leaching potential).

22         Risk-ranking methods are applied to help target more detailed analysis towards  
23 critical risks and to inform the prioritisation of catchment management activities,  
24 specifically monitoring programmes. Of course, the potential exists that as the costs  
25 of planned monitoring decrease on the one hand, the risks may increase on the other.  
26 When designed well, piloted and implemented with feedback, risk-based resourcing

1 strategies (Figure 6) can provide a sound basis for distinguishing greater risks from  
2 lesser ones, and for investing resources in risk management that are proportional to  
3 the risks posed.<sup>122</sup>

4 Most critically, however, these risk-based optimisation tools, whether intended  
5 to drive monitoring regimes, maintenance schedules or workforce planning, may  
6 themselves incur significant risk unless the consequences of resource trade-offs are  
7 themselves assessed. Consider the actions of the Saskatchewan Department of  
8 Environment and Resource Management (SERM) prior to the North Battleford  
9 *cryptosporidiosis* outbreak in April 2001.<sup>121</sup> SERM held legislative responsibility for  
10 the Saskatchewan drinking water programme and, partly in response to budget cuts in  
11 the mid 1990s, drastically reduced the already limited field inspection and  
12 enforcement of municipal utilities. This culminated in SERM proposing to eliminate  
13 its drinking water programme altogether, a motion tentatively approved by the  
14 Treasury Board in 2000/01 and justified as being ‘risk-based’. The subsequent North  
15 Battleford outbreak, infecting between 5800 to 7100 persons in the immediate  
16 community plus a large number of visitors from three other provinces, led to a public  
17 inquiry into the outbreak and the provincial drinking water regulatory system. Justice  
18 Laing<sup>76</sup> concluded in his Inquiry report: *“that the current risk-based model employed*  
19 *by SERM since 1996 is arrived at on the basis of economics, and has nothing to do*  
20 *with how best to safeguard the health of the population, all of whom consume water”*.  
21 The example aptly illustrates the inappropriate use of risk analysis as a justification  
22 for the removal of processes critical to public health protection. Tensions that arise  
23 between those seeking economic efficiencies and preservation of the principal goal of  
24 providing safe drinking water are often played out in the conflicting expectations and  
25 presumed purposes of risk analysis made by different professionals. The real  
26 consequences of stripping away levels of safety, precaution and protection using ‘risk

1 analysis' as a justification can be to render the system as a whole less safe, more  
2 precarious and more susceptible to catastrophic failure and so optimisation  
3 programmes, maintenance schedules and risk-based monitoring require special  
4 scrutiny as to the balance between risk and the full cost of implementing these  
5 programmes.

6 Where more detailed analysis is deemed necessary, a common recourse is to  
7 model-based approaches. Water quality and flow / transport models represent core  
8 tools for this purpose, due to their combined ability to model the dispersal of  
9 pollutants and predict the resultant deterioration of water quality. Aside from the  
10 inherent value of fostering an increased understanding of catchment water quality  
11 issues, the core benefits of model-based analysis stems from their ability to test  
12 management scenarios (through *e.g.* sensitivity and scenario analysis), thus enabling  
13 informed decisions on how best to manage the resource. A range of models are  
14 available that apply to catchment risk analysis, from micro to landscape scales, from  
15 deterministic to stochastic approaches (Table 3).

16 Common practices of hydrological and water quality modelling have been based  
17 mostly on deterministic analysis, producing single point estimates that neglect  
18 prediction uncertainty.<sup>2</sup> Determinism has been embraced by many risk analysts, for  
19 example, Gündüz *et al.*<sup>56</sup> describe the use of the combined hydrodynamic and water  
20 quality model CE-QUAL-W2 in projecting potential water quality degradation  
21 patterns under different pollution loads. The tool is intended to aid management in  
22 the development of appropriate strategies for the management of water quality.  
23 Similarly deterministic approaches to catchment analysis are described by various  
24 other researchers (*e.g.* Cole *et al.*<sup>25</sup>). The limitations of determinism in risk analysis,  
25 discussed earlier, are particularly relevant in the context of hydrological and water  
26 quality modelling, considering the often scarce or incomplete data available.<sup>89</sup> This

1 uncertainty takes on particular importance from the utility standpoint, as their  
2 assessments of catchment water quality are performed with regard to set regulatory  
3 standards. To illustrate this point, the uncertainties inherent in flow and contaminant  
4 transport modelling (from *e.g.* spatial variability, data scarcity, model imperfections)  
5 imply that there will always be a risk of exceeding a given standard at some point  
6 over space or time following a pollution event, regardless of the estimated single-  
7 point (mean) contaminant levels.<sup>2</sup>

8       An argument can thus be forwarded for the explicit consideration of prediction  
9 uncertainties in catchment level risk modelling. There exist two dominant approaches  
10 towards this task: stochastic modelling; and deterministic modelling allied with  
11 uncertainty analysis of the output. Adopting the former approach, Andersson and  
12 Destouni<sup>2</sup> outline the application of stochastic transport modelling to quantify the risk  
13 of exceeding regulatory standards for groundwater at any point on the compliance  
14 boundary. This quantification is coupled with an analysis of the abatement costs  
15 required to attain an ‘acceptable’ risk level. Halfacree,<sup>61</sup> for example, describes the  
16 use of PRAIRIE, an aquatic dispersion modelling tool for assessing chemical  
17 pollution risks to water bodies. The main elements are an aquatic dispersion model;  
18 hydrological, substance and standards databases; and a tabular / graphical output  
19 facility. The model has a deterministic mode used to ‘screen out’ low risk sites, and a  
20 probabilistic mode for more detailed analysis of high risk sites. The output results  
21 (*e.g.* frequency versus concentration curves) are compared with pre-determined  
22 criteria to inform regulatory actions on risk management from hazardous activities  
23 within a sensitive catchment. An advantage of the stochastic approach is that  
24 uncertainty is interwoven within the model.<sup>175</sup> However, the solution of stochastic  
25 equations is often impractical for complex problems.<sup>81</sup> This explains, in part, the

1 preference for deterministic approaches to water quality / hydrological modelling,  
2 creating the subsequent need for external consideration of output uncertainty.

3 In this context, uncertainty analysis is performed to estimate the probability of  
4 obtaining a given output value when uncertainties on input variables and parameters  
5 are known.<sup>89</sup> Liou and Yeh<sup>84</sup> outline the use of a groundwater transport model in  
6 deriving the risk of contaminant concentration exceeding a maximum acceptable  
7 upper limit (*e.g.* regulatory standard). The analytical uncertainty of the predicted  
8 contaminant concentration is derived by first-order mean-centred uncertainty analysis,  
9 prior to the application of Monte Carlo simulation in order to compute the mean risk  
10 and associated confidence interval of exceeding standards. For detailed discussions of  
11 the forms of uncertainty in water quality modelling and the techniques for their  
12 analysis, see Mailhot and Villeneuve;<sup>89</sup> Portielje *et al.*;<sup>123</sup> and Beck.<sup>11</sup>

13 In the event of pollution leading to a violation of water quality standards,  
14 remediation may be required. Researchers have developed methodologies for  
15 optimising remediation strategies (*e.g.* Rogers *et al.*<sup>132</sup>). However, as Latinopoulos *et*  
16 *al.*<sup>80</sup> contend, if the inability to meet the constraints of a groundwater quality  
17 programme is considered a significant risk, then quantifying the risk of remediation  
18 failure in terms of failure to comply with regulatory standards is a primary task. In  
19 relation to this, Latinopoulos *et al.*, through coupling stochastic flow and transport  
20 simulations with a risk-cost-benefit objective function, have developed a methodology  
21 facilitating the risk-based evaluation of remediation strategies (costing the risk of  
22 failure in terms of regulatory fines and the need to import / develop alternative  
23 supplies).

24 An alternative approach to characterising the extent and severity of source  
25 contamination is that of geostatistical inference (*e.g.* Passarella *et al.*;<sup>118</sup> Wingle *et*  
26 *al.*;<sup>171</sup> Rautman and Istok<sup>129</sup>). These kriging methods – essentially a form of least

1 squares linear regression – focus on providing an estimate of a spatially distributed  
2 variable (*e.g.* contaminant concentration) at unsampled locations as a function of a  
3 limited set of sample values taken from surrounding locations.<sup>129</sup> As such, they are  
4 ideally suited to groundwater quality issues, where data collection is limited by  
5 expense and access. Of particular relevance to risk analysis is the discipline of  
6 geostatistical simulation, where multiple, unique estimates of site conditions that  
7 mimic the random variability of the parameter(s) of concern are produced.<sup>171</sup> Various  
8 authors<sup>118,171,129</sup> have illustrated how such an approach may answer the following  
9 questions: what is the probability that contaminant levels exceed regulatory standards;  
10 where are the compliance boundaries (and what is the associated level of confidence);  
11 and how much contaminant is present (and hence, how much must be removed)?  
12 Although the principles of geostatistical simulation are well established, the technique  
13 has yet to be widely applied to problems of groundwater contamination.<sup>129</sup>

14 Applications of GIS to catchment risk analysis were discussed earlier in the  
15 context of risk-mapping. Although representing efficient risk screening tools, their  
16 ability to quantify risk over space *and* time is limited. To counter this, researchers  
17 have sought to integrate these systems with simulation models. Feijtel *et al.*<sup>44</sup>  
18 illustrate that the embedding of chemical fate prediction models within a GIS allows  
19 for calculation of the distribution of predicted environmental concentrations, both in  
20 space and time, of ‘down-the-drain’ chemicals in catchment surface waters. Similar  
21 approaches are adopted by Dabrowski *et al.*<sup>30</sup> and Verro *et al.*<sup>164</sup> to assess surface  
22 water pesticide loading.

23

24

## 25 **C. Network analysis**

26

1           A water distribution system may be viewed as an interconnected collection of  
2 sources, pipes, and hydraulic control elements (*e.g.* pumps, valves, regulators, tanks)  
3 delivering water to consumers in prescribed quantities and at desired pressures.<sup>112</sup>  
4 System behaviour, which is governed by hydraulics, supply, demand, and system  
5 layout, may be described mathematically.<sup>112</sup> This description forms the basis of water  
6 supply and distribution modelling (network analysis), a discipline practised in the  
7 water industry for many years, particularly to inform the development of operational  
8 strategies.<sup>154,17</sup> Water utilities routinely apply network analysis in order to assess their  
9 ‘security of supply’, defined as the probability of being able to meet consumer  
10 demands (*i.e.* network reliability). ‘Best practice’ utilities extend their analysis  
11 beyond routine operating conditions to examine network performance under various  
12 supply-demand scenarios, thus reflecting the inherent uncertainty of the supply-  
13 demand balance. The standard Scottish Water methodology of yield assessment uses  
14 the software tool HYSIM-AQUATOR.<sup>82</sup> HYSIM, a hydrological rainfall-runoff  
15 simulation model, is used to derive historic inflow series, based on historic rainfall,  
16 potential evapotranspiration, and if necessary any artificial influences (*e.g.*  
17 abstractions). AQUATOR, a water resource system model, uses the output from  
18 HYSIM to simulate reservoir storage based on system demands and compensation  
19 flows. The model assists Scottish Water in understanding the level of supply  
20 availability risk in the current system and in determining the impact of prospective  
21 investment strategies to mitigate this risk.

22           Stevens and Lloyd<sup>150</sup> describe the application of the resource modelling package  
23 WRAPsim, with reference to the Yorkshire Water (UK) Grid. The model contains  
24 over 1200 components including all river and reservoir sources, boreholes, water  
25 treatment works, pipelines and demand centres. Through simulation of the  
26 conjunctive use of Yorkshire Water’s sources over a given time period, model output

1 provides the decision-maker with an accurate assessment of the behaviour of each  
2 source, its ability to meet demand, and the frequency of restrictions that would need to  
3 be imposed. Further insights are gleaned through the application of scenario analysis,  
4 wherein the supply-demand balance for each zone under variable scenarios (*e.g.*  
5 average year, dry year, peak week, *etc.*) allows an assessment of security of supply  
6 over a range of timescales and operating conditions. The authors report that  
7 WRAPsim's ability to predict future supply conditions, to optimise allocation of water  
8 resources, and to rebalance stocks, has significantly increased the yield and reliability  
9 of Yorkshire Water's supply system.<sup>150</sup>

10       Stahl and Elliott<sup>149</sup> discuss Essex and Suffolk Water (ESW)'s use of the risk-  
11 based resource planning and operational support model DROP (Drought Reliable  
12 Output Programme), an adaptation of WRAPsim designed to accommodate the  
13 utility's specific technical requirements. The model has been applied in a variety of  
14 areas, particularly in support of investment planning and the determination of  
15 operational strategies. The authors state that DROP has enabled ESW to improve  
16 their understanding of system performance, identify new schemes or short term  
17 options to improve reliability of supply, and to more accurately determine future  
18 operating costs associated with new developments. Such methodologies, although  
19 able to examine system reliability under a range of operating conditions, do not  
20 adequately address whether the system is *sufficiently* reliable, as this requires the  
21 definition and quantification of appropriate and meaningful reliability measures, a  
22 computationally difficult task.<sup>113</sup> Harnessing developments in computer processing  
23 power and operability, Ostfeld<sup>113</sup> has developed a methodology for the explicit  
24 reliability analysis of water distribution networks, with reliability defined, quantified  
25 and measured as the probability of zero annual shortfalls. The methodology, whose  
26 development was funded with the intention of practical application by the Israeli

1 Water Commission, is comprised of two interconnected stages: (i) analysis of the  
2 storage-conveyance properties of the system; and (ii) implementation of stochastic  
3 simulation through use of RAPTOR (Rapid Availability Prototyping for Testing  
4 Operational Readiness) software.

5 However, researchers in the field of network analysis are increasingly aware of  
6 the need to take account of both the frequency and severity of modelled failures, and  
7 as a result analyses are often suggested to extend beyond measures of reliability to  
8 incorporate resiliency (*e.g.* the capacity of a system to recover to a satisfactory state  
9 from a state of failure) and vulnerability (*e.g.* a measure of failure significance).<sup>165, 71</sup>

10 Adopting this paradigm, Zongxue *et al.*<sup>174</sup> describe the coupling of a risk model  
11 (comprising measures of reliability, resiliency and vulnerability), which incorporates  
12 predictions of water demand, with a traditional network simulation model. The  
13 approach aids the identification of operational strategies of minimum risk under given  
14 supply and demand scenarios, and is illustrated by application to Fukuoka Water  
15 Supply System, Japan (see also Jinno *et al.*<sup>71</sup>). Similar methodologies are described  
16 by Wang *et al.*;<sup>165</sup> Merabtene *et al.*;<sup>96</sup> and Andreu *et al.*<sup>3</sup> though supplemented with  
17 formal optimisation procedures to assist derivation of the most appropriate operational  
18 policies of minimum risk.

19 To summarise, network analysis can: (a) allow utilities to assess their  
20 susceptibility to various supply-demand scenarios (*e.g.* drought or increases in  
21 demand); (b) aid decision-makers in determining ‘optimal’ supply strategies and  
22 policies; (c) assist in the design phase of distribution networks; and (d) inform the  
23 need for capital expenditure.

## D. Vulnerability assessments

Operational disruptions are the inevitable result of large-scale disasters (*e.g.* flooding, drought, earthquakes, terrorism). To minimise the risks posed by such ‘uncontrollable’ events, utilities must seek to eliminate or reduce their potential consequences – this is best achieved through contingency and emergency planning.<sup>142</sup> The role of formal risk analysis in emergency planning, long restricted to drought management, is now being widely adopted to address security risks. This is largely in response to the events of September 11<sup>th</sup>, 2001. In relation to this, a methodology for vulnerability assessments has been developed by Sandia National Laboratories (SNL) – known as Risk Assessment Methodology for Water Utilities (RAM-W). The methodology allows utilities to conduct a detailed assessment of their system vulnerabilities and to develop measures to reduce the risks and mitigate the consequences of terrorist or other criminal attacks.<sup>147</sup> The assessment comprises three steps:<sup>147</sup>

- 1) determine how well the system detects a problem, which involves surveying all security and monitoring features (*e.g.* how quickly could it detect an undesired chemical being introduced to the supply);
- 2) measure delay capabilities in order to determine how well a system can stop undesired events (*e.g.* security in place, length of storage time); and
- 3) measure the capacity of private guard forces and local, state and federal authorities to respond to an event.

Perhaps a more pragmatic approach, particularly for smaller utilities, is found in the questionnaire-based self-assessment developed by the National Rural Water Association.<sup>107</sup>

#### **4. OPERATIONAL RISK ANALYSIS**

Our review now progresses to the analysis of individual plant. Operational risk managers are responsible for the risks associated with specific operations at plant level – for example, the risk of failure of a device or process component, or the risk of exceeding a particular water quality standard and they are increasingly responsible for the health and safety of plant operatives. Analysis at this level is largely concerned with the ‘classic’ risk analysis methodologies developed and established within other process industries, most notably the oil and chemical sectors (Table 5).

##### **A. Public health and compliance risk**

Here, we are primarily concerned with the risk posed by specific contaminants at the plant and distribution system level, particularly relating to the hazards posed to human health and the related risk of exceeding regulatory standards. The multiple barrier approach to water treatment has been the central tenet of modern water treatment systems and relies upon the use of ‘in-series’ water treatment processes to remove hazardous agents from the public water supply. Failure or inadequacy of the treatment and distribution process can result in an interruption of supply and / or derogation in water quality (microbiological or chemical) with potential impacts on

1 public health. The underlying causes may include source contamination, human error,  
2 mechanical failure or network intrusion. The consequences of process failure can be  
3 immediate, there is very little time if any to reduce exposure because of the lag in  
4 securing monitoring data and the impacts can affect a large number of people  
5 simultaneously.<sup>121</sup> Beyond the paramount impacts on public health through the direct  
6 ingestion of contaminated drinking water, financial and consumer confidence impacts  
7 invariably ensue. The financial costs to the community of the fatal Walkerton  
8 outbreak for example, were in excess of Cdn\$65 million, with one time costs to  
9 Ontario estimated at more than Cdn\$100 million.<sup>108</sup> Compounding this, the loss of  
10 consumer confidence following disease outbreaks is often enormous.<sup>67</sup> Even when  
11 there is no legislation covering certain aspects there can be claims of negligence  
12 against operating companies. Litigation for civil damages have been prominent  
13 features following both the Walkerton outbreak (settled out of court) and the Sydney  
14 Water crisis (largely dismissed, costs still incurred).<sup>121</sup>

15 Conventionally, the public health impacts of drinking water consumption have  
16 been assessed retrospectively using epidemiological studies.<sup>69</sup> Recognition of the  
17 need for a preventative approach to managing risk and providing safe drinking water,  
18 however, has driven international interest in the application of risk assessment  
19 methodologies within the sector, for both chemical and microbiological hazards.<sup>5, 59</sup>  
20 The generic approach is based on the risk assessment framework developed by the  
21 National Academy of Sciences (NAS),<sup>103</sup> which consists of four key steps:<sup>59</sup>

- 22 • problem formulation and hazard identification – to describe the human health  
23 effects derived from any particular hazard (e.g. infection, carcinogenicity, etc.)
- 24 • exposure assessment – to determine the size and characteristics of the  
25 population exposed and the route, amount, and duration of exposure

- 1       • dose-response assessment – to characterize the relationship between the dose
- 2       exposure and the incidence of the health effects
- 3       • risk characterization – to integrate the information from exposure, dose-
- 4       response, and health interventions in order to estimate the magnitude of the
- 5       public health problem and to evaluate variability and uncertainty

6

7       Several substantive differences exist between assessment of risk of microbial  
8 agents and assessment of risk of chemicals.<sup>58</sup> Accordingly, the NAS approach has  
9 been adapted to account for the dynamic and epidemiologic characteristics of  
10 infectious disease processes,<sup>45</sup> to form what is known as quantitative microbial risk  
11 assessment (QMRA). The application of these models has long been the basis for the  
12 derivation of water quality guidelines for drinking water.<sup>168</sup> The substance-specific  
13 health risk assessments that have historically informed the guidelines may, however,  
14 be somewhat distanced from the immediate operational context of individual  
15 utilities.<sup>121</sup> However, recent work has extended the application of these models to the  
16 operational (plant-specific) context. For example, Medema *et al.*,<sup>95</sup> Masago *et al.*,<sup>90</sup>  
17 and Teunis *et al.*<sup>156</sup> describe the application of QMRA in determining the public  
18 health risks posed by the presence of microbial contaminants in treated water. The  
19 first step in the process is to define the relationship between measured pathogen  
20 source levels and the consumed dose (incorporating analytical detection levels,  
21 treatment removal efficiencies, drinking water consumption), followed by the  
22 construction of a deterministic model mathematically describing this relationship.  
23 Monte Carlo simulation (a method of uncertainty analysis) is then applied to the  
24 output of the deterministic model to determine the distribution of the daily consumed  
25 dose, to which the relevant dose response relationship is applied in order to determine

1 the cumulative distribution of the probability of infection. From this, the mean annual  
2 individual risk of infection may be determined. Such approaches are of particular  
3 relevance in areas, such as the Netherlands, where water supply legislation expresses  
4 acceptable health risks in terms of infections per year.<sup>95</sup> Of course, core microbial  
5 standards generally refer to a maximum level of organisms in the treated water, and so  
6 consideration of consumption levels and the dose-response relationship is superfluous  
7 to compliance risk assessment. The approach perhaps has most utility in ‘what-if’  
8 mode to answer questions such as: “*what are the public health implications of a*  
9 *failure of part of the treatment process or of a re-designing of the treatment*  
10 *process*”.<sup>52</sup>

11 Tools are available to assess the risk of exceeding water quality standards  
12 relating to physical or chemical parameters. For example, Demotier *et al.*<sup>32</sup> describe  
13 an integrated FTA / FMEA approach to determining the risk of producing non-  
14 compliant drinking water across a range of parameters, taking into account the quality  
15 parameters of raw water and the removal efficiencies and reliability of the full set of  
16 treatment processes. Similar methodologies are described by Eisenberg *et al.*<sup>41</sup> and  
17 Haas and Trussell<sup>57</sup> in assessing the reliability of multiple, independent barriers in  
18 water treatment. These three pieces of research explicitly consider the performance  
19 variability of individual processes along the treatment line, an approach rarely  
20 described in operational QMRA. Not only does this offer a more realistic appraisal of  
21 compliance risk, it is in line with recent proposals from regulatory bodies (*e.g.*  
22 National Health and Medical Research Council (NHMRC))<sup>105</sup> calling on utilities to  
23 formally adopt the multiple barrier approach to risk management to ensure multiple  
24 levels of protection are afforded against specific contamination threats (see Rizak *et*  
25 *al.*<sup>131</sup>).

Of course, limitations in resources (human and financial) and in the data to underpin such sophisticated analyses often restrict the practical application of these more advanced methodologies within the sector. A more pragmatic analysis of the risks of process failure is commonly undertaken using a semi-quantitative risk-ranking of hazards according to their likelihood and consequence. Egerton<sup>40</sup> describes the application of ranking techniques for the prioritisation of contamination risks at a water treatment plant. Risks are scored according to the frequency with which they may occur, the ability to take action to contain the event, and the consequence of subsequent contamination. The methodology is intended to aid the targeting and prioritisation of remedial actions. Such approaches rely heavily on the experience and judgement of the assessment team, and depending on the level of guidance provided for scoring within these criteria, remain open to bias especially from unforeseen circumstances that often fall beyond the process boundary, *e.g.* deliberate or accidental human error.

Finished water can undergo a variety of physical, chemical, and biological changes during transportation through a distribution system.<sup>13</sup> Understanding the nature and likelihood of these risks has become a priority for water producers,<sup>13</sup> in part due to research linking such degradation to the incidence of gastrointestinal illnesses (*e.g.* Payment *et al.*<sup>119</sup>). Application of the methodologies developed by Lindley and Buchberger<sup>83</sup> and Besner *et al.*,<sup>13</sup> described earlier (see *Asset management*), would provide utilities with a means to distinguish areas of the distribution system at greatest risk of degradation, providing a framework for prioritising risk management activities.

## **B. Reliability analysis**

1           It is implicit in the planning, design and operation of water utilities that risk  
2   analysis is a qualitative component of the intellectual process of the experienced  
3   engineer / operator. Reliability analysis seeks to formalise, systemise, and, where  
4   necessary, quantify this process. Assessments of operational reliability range from  
5   component (*e.g.* risk of valve failure), process (*e.g.* risk of failure of treatment step) to  
6   network (*e.g.* network reliability under drought conditions, see *Network analysis*)  
7   level analysis. Regardless of focus, the aim is to identify the potential failures that  
8   may occur in a system, their effects and their likelihood, thus aiding the identification  
9   of critical components and processes where design and operational changes are  
10   required to meet safety and / or production targets.<sup>151</sup> Analysis may be summarised as  
11   follows:<sup>151</sup>

12

- 13           • system definition – defining the level of analysis;
- 14           • failure identification – identifying potential hazards (*e.g.* HACCP, hazard and  
15           operability studies, FMEA / FMECA);
- 16           • reliability modelling – to describe failure behaviour of system as a whole  
17           (*e.g.* FTA, ETA, reliability block diagrams); and
- 18           • sensitivity analysis

19

20           The National Health and Medical Research Council (NHMRC), the body  
21   responsible for issuing drinking water guidelines to Australian water utilities, in their  
22   ‘Framework for Management of Drinking Water Quality’<sup>131,105</sup> advocated the  
23   application of a HACCP (hazard analysis critical control points) methodology, namely  
24   the determination of ‘critical control points’ whereupon risks can be monitored and  
25   reduced.<sup>24</sup> Hellier<sup>64</sup> describes the implementation of this approach within Melbourne  
26   Water (Australia). The process begins with the division of the water system into four

1 discrete subsystems: catchment, treatment, distribution and customer premises.  
2 Across each subsystem (*e.g.* catchment) the sources of risk to water quality (*e.g.*  
3 native animals) and the associated hazards (*e.g.* bacteria, viruses) are identified and  
4 plotted on a simple risk matrix; those risks deemed to be significant are evaluated  
5 further for their critical control points. Assessors then identify the critical limits,  
6 monitoring systems and corrective actions for each CCP. The application of HACCP  
7 to South East Water Ltd.'s (Australia) distribution and reticulation systems is  
8 described in Mullenger *et al.*<sup>101</sup> Through implementing their HACCP plan, the  
9 company has developed a greater understanding of water quality issues, refined and  
10 optimised operating procedures, and observed a net decrease in customer complaints.  
11 These benefits stem from an increased knowledge and understanding of the water  
12 supply system and an improved ability to identify potential risks to water supply /  
13 quality.<sup>101</sup> Beyond managing existing process control, HACCP may also be used to  
14 assess and manage the risks from proposed operational changes, such as the  
15 integration of treated domestic wastewater to an existing potable production process  
16 (*e.g.* Dewettinck *et al.*<sup>34</sup>).

17 HAZOP (hazard and operability study), a technique developed by Imperial  
18 Chemical Industries Ltd., systematically evaluates the process and engineering  
19 intentions of new or existing facilities in order to identify the hazards that may arise  
20 due to deviations from design specifications.<sup>1</sup> Typically, a carefully selected team  
21 examines a process (*e.g.* disinfection) subdivided into 'nodes', at each node, the team  
22 applies guidewords (*e.g.* low) to process parameters (*e.g.* ozone levels) to identify  
23 ways in which the process may deviate from its design intention, before evaluating the  
24 causes and consequences of the deviation. A technical document published by the US  
25 Department of Energy<sup>162</sup> describes the undertaking of a HAZOP study on the partially  
26 installed chlorination process of a water treatment facility. The analysis, conducted in

1 response to regulatory requirements, identified the key areas of uncertainty (*e.g.*  
2 chlorine cylinder received overfilled). ‘Action items’ and recommendations were  
3 formulated to clarify these uncertainties and to verify process conditions (*e.g.* check  
4 pressure potential from the chlorine cylinder and the system response).

5       The practical implementation of many of these techniques is often constrained  
6 by the institutional capacity of organisations and the skill sets available at the  
7 operational level. Risk analysis remains an expert discipline and many organisations  
8 are more comfortable with the historic and proven implicit approach to risk  
9 management. Nevertheless, we are witnessing a growing number of utilities making  
10 their analysis more explicit and using these tools for better decision-making,  
11 identifying risk issues early rather than later, when their ability to respond may be  
12 compromised. At Scottish Water, for example, FMECA-based studies are performed  
13 at the operational level. Targeted by a risk criticality scoring system, the analysis  
14 systematically considers various components of the water supply system and their  
15 respective failure modes.<sup>82</sup> As the scoring system is ‘pseudo-economic’, decision-  
16 makers are empowered to assess the costs and benefits in terms of risk reduction per  
17 pound of mitigation efforts through undertaking simple scenario modelling.<sup>82</sup> Where  
18 identified failure modes are traced to specific mechanical or electrical equipment, the  
19 equipment is subject to reliability centred maintenance – the risk-based prioritisation  
20 of maintenance activities. In recognition of the dangers of ill-informed risk-based  
21 resourcing, select critical-risk assets undergo formal optimisation of maintenance task  
22 cost-risk-performance using a suite of asset performance tools (APT).

23       These methodologies represent an informed and structured, if time-consuming,  
24 framework for pinpointing weaknesses in utility design and operation. Applied  
25 effectively using personnel with appropriate skills, experience and resources, they  
26 provide operational management with a basis for improving process reliability and

1 identifying issues early. Ineffectively applied, they become little more than acronyms  
2 for complacency. As discussed, reliability analysis may require a quantitative  
3 treatment of the effect of identified risks at the system level. The importance and  
4 complexity of this task has increased in recent years, due in part to the increased range  
5 of available technologies and the tighter operational margins imposed by regulators.<sup>41</sup>

6 For unreliable or heavily used equipment, an analysis of historic data may be  
7 sufficient for this purpose. In the absence of such data, there is a requirement for the  
8 formal modelling of risk consequences. There exist a range of techniques for this  
9 task, including logic modelling (*e.g.* Demotier *et al.*;<sup>32</sup> Cyna<sup>29</sup>), ‘quantitative’ FMECA  
10 (*e.g.* Cyna), and multiple barrier approaches to treatment reliability (*e.g.* Demotier *et*  
11 *al.*; Eisenberg *et al.*<sup>41</sup>; Haas and Trussell<sup>57</sup>). An illustration of an integrated approach  
12 to evaluating plant reliability is provided by Cyna, who describes the methodology  
13 developed and applied by the *Compagnie Generale des Eaux* (France) (Figure 7).  
14 Following system definition and modelling (*via* reliability block diagrams), risks are  
15 identified and classified using HAZOP. Risk consequences are subsequently  
16 quantified *via* FMECA, allowing the computation of system availability (the  
17 probability of the system to be found operative at a given time). Cyna describes how  
18 the methodology was applied to a proposed post-chlorination system in *Neuilly-sur-*  
19 *Marne* plant, arguing that its employment helped conceive a reliable system and  
20 verified the adequacy of plant availability. The author concludes that reliability  
21 analysis is an essential tool at ‘conception’, which allows the adjustment of project  
22 design, and thus cost, to the level of reliability required, and, when associated with  
23 maintenance procedures, can provide insurance of design quality.

## 24 25 26 **5. CONCLUSION**

1

2 Risk management for water utilities is fast becoming an explicitly-stated  
3 paradigm, recognising the implicit approach performed over the last 150 years. With  
4 increasing globalisation, outsourcing and increased regulation of the industry, tools  
5 that allow system vulnerabilities to be identified before failures occur are essential. In  
6 many ways, however, the industry is discovering risk analysis afresh and there is a  
7 learning curve to climb in terms of the capabilities and limitations of these tools and  
8 techniques. The international water sector has helpfully restated its overarching goal  
9 reminding us that even in the face of rationalisation and economic pressure, public  
10 health protection<sup>8</sup> is the principal business of the water industry. Risk analysis has a  
11 part to play in focussing effort in the right places, but should not be treated as a  
12 panacea or substitute for managing risk and neither allowed to dictate the outcome of  
13 decisions without recourse to the fundamental goal of the business. Flexibility of  
14 approach is key to the successful application of these tools, as is their appropriate  
15 selection within the organisational context and legal framework. For large multi-  
16 utilities, one can expect high developed business risk capabilities, whereas for smaller  
17 and single utilities, an approach based on accepted codes and standards may be more  
18 suitable. Our analysis provide a comprehensive inventory of the current state-of-the-  
19 art as a reference for developing a risk analysis strategy that is fit for purpose.

20

## 21 **ACKNOWLEDGEMENTS**

22

23 This work has been funded by the American Water Works Association Research  
24 Foundation (AwwaRF project RFP2939), Yorkshire Water Services, the Canadian  
25 Water Network and a consortium of international water utility companies and  
26 organisations. The comments and views herein are the authors' alone. Brian

MacGillivray is co-funded on a UK Engineering and Physical Sciences Research Council Doctoral Training Account.

## REFERENCES

1. American Institute of Chemical Engineers, *Guidelines for Hazard Evaluation Procedures*, 2<sup>nd</sup> Edition, American Institute of Chemical Engineers, New York, 1992, 64-67
2. Andersson, C. and Destouni, G., Risk-cost analysis in ground water contaminant transport: the role of random spatial variability and sorption kinetics, *Ground Water*, **39**(1), 35, 2001.
3. Andreu, J., Capilla, J. and Sanchis, E., AQUATOOL, a generalized decision-support system for water resources planning and operational management, *J. Hydrol.*, **177**, 269, 1996.
4. Anon., Retention risk assessment, *Incentive*, **175**(2), 68, 2001.
5. Ashbolt, N.J., Risk analysis of drinking water microbial contamination versus disinfection by-products (DBPs), *Toxicology*, **198**, 255, 2004.
6. Asian Development Bank (ADB), *Handbook for the Economic Analysis of Water Supply Projects*, ADB, 1999. (website: [http://www.adb.org/Documents/Handbooks/Water\\_Supply\\_Projects/default.asp](http://www.adb.org/Documents/Handbooks/Water_Supply_Projects/default.asp))
7. Asian Development Bank (ADB), *Proceedings of the regional forum on regulatory systems and networking of water utilities and regulatory bodies*, ADB, 2001. (website: [http://www.adb.org/Documents/Conference/Water\\_Uilities/default.asp](http://www.adb.org/Documents/Conference/Water_Uilities/default.asp)).

- 1 8. AWWA, EUREAU, WSAA and DVGW, *Bonn Workshop 2001 – Key principles*  
2 *in establishing a framework for assuring the quality of drinking water: a*  
3 *summary*, AWWA, Denver, CO., 2001.
- 4 9. Barney, S.M., Retaining our workforce, regaining our potential, *J. Healthcare*  
5 *Manage.*, **47**(5), 291, 2002.
- 6 10. Barreix, A., Jenkins, G.P. and Marchesini, M., *Case 1. Restructuring the water*  
7 *and sewer utility in Panama*, World Bank, 2003. (website:  
8 [http://130.15.74.22/publications/panama\\_water.pdf](http://130.15.74.22/publications/panama_water.pdf)).
- 9 11. Beck, M.B., Applying systems analysis in managing the water environment:  
10 towards a new agenda, *Wat. Sci. Tech.*, **36**(5), 1, 1997.
- 11 12. Berry, M.A., Burmeister, E. and McElroy, M.B., Sorting out risks using known  
12 APT factors, *Financial Analysts J.*, **44**(2), 29, 1988.
- 13 13. Besner, M-C., Gauthier, V., Barbeau, B. and Millette, R., Understanding  
14 distribution system water quality, *J. AWWA*, **93**(7), 101, 2001.
- 15 14. Black, F. and Scholes, M., The pricing of options and corporate liabilities, *J.*  
16 *Politic. Econ.*, **81**(3), 637, 1973.
- 17 15. Boak, R.A. and Packman, M.J., A methodology for the assessment of risk of  
18 *Cryptosporidium* contamination of groundwater, *Quarterly J. Engg. Geol.*  
19 *Hydrogeol.*, **34**(2), 187, 2001.
- 20 16. Booth, R. and Rogers, J., Using GIS technology to manage infrastructure capital  
21 assets, *J. AWWA*, **93**(11), 62, 2001.
- 22 17. Brammer, L.F. and Schulte, A.M., A joint US and UK approach to water supply  
23 and distribution modelling, *J. IWEM*, **7**, 471, 1993.
- 24 18. Brueck, T., Facing the workforce reality: making more out of less, *J. AWWA*,  
25 **94**(6), 34, 2002.

- 1 19. Buckland, R. and Fraser, P., Political and regulatory risk in water utilities: Beta  
2 sensitivity in the United Kingdom, *Journal of Business Financing and*  
3 *Accounting*, **28**(7/8), 877, 2001.
- 4 20. Bunn, D.W., Dyner, U. and Larsen, E.R., Modelling latent market power across  
5 gas and electricity markets, *Syst. Dynam. Rev.*, **13**, 271, 1997.
- 6 21. Burchett, J.F. and Tummala, V.M.R., The application of risk management  
7 process in capital investment decisions for EHV transmission line projects,  
8 *Constr. Manage. Econ.*, **16**, 235, 1998.
- 9 22. Clark, T., Jeffrey, P. and Stephenson, T., Complex agendas for new technology  
10 adoption in the UK water industry, *Technovation*, **20**, 247, 2000.
- 11 23. Clemons, E.K., Using scenario analysis to manage the strategic risks of  
12 reengineering, *Sloan Manage. Rev.*, **36**(4), 61, 1995.
- 13 24. Codex Alimentarius, *Guidelines for the Application of the Hazard Analysis and*  
14 *Critical Control Point (HACCP) System*, ALINORM 93 / 13A, Appendix 2,  
15 WHO, Geneva, 1993.
- 16 25. Cole, J.A., Hawker, P.J., Lawson, J.D. and Montgomery, H.A.C., Pollution risks  
17 and countermeasures for surface water intakes, *J. IWEM*, **2**, 603, 1988.
- 18 26. Colmer, G., Dunkley, M., Gray, K., Pugh, P. and Williamson, A., Estimating the  
19 cost of new technology products, *Intl. J. Technol. Manage.*, **17**(7/8), 840, 1999.
- 20 27. Cowan, S., Competition in the water industry, *Oxford Rev. of Econ. Policy*,  
21 **13**(1), 83, 1997.
- 22 28. Crowe, T.J., Fong, P.M., Bauman, T.A. and Zayas-Castro, J.L., Quantitative risk  
23 level estimation of business process reengineering efforts, *Business Proc.*  
24 *Manage. J.*, **8**(5), 490, 2002.
- 25 29. Cyna, B., Reliability analyses of water treatment plants, *Water Supply*  
26 *(Amsterdam)*, **15**(2), 65, 1997.

- 1 30. Dabrowski, J.M., Peall, S.K.C., Van Niekerk, A., Reinecke, A.J., Day, J.A. and  
2 Schulz, R., Predicting runoff-induced pesticide input in agricultural sub-  
3 catchment surface waters: linking catchment variables and contamination, *Wat.*  
4 *Res.*, **36**, 4975, 2002.
- 5 31. Dean, A., Carlisle, Y. and Baden-Fuller, C., Punctuated and continuous change:  
6 the UK water industry, *Brit. J. Manage.*, **10**, S3, 1999.
- 7 32. Demotier, S., Odeh, K., Schon, W., Charles, P., Fotoohi, F. and Allieux, J-F.,  
8 *Risk assessment for drinking water production process*, 2002. (website:  
9 <http://www.hds.utc.fr/~tdenoeux/sime/publis/esrel2002.pdf>).
- 10 33. Denton, D.K., Keeping employees: the Federal Express approach, *S.A.M. Adv.*  
11 *Manage. J.*, **57**(3), 10, 1992.
- 12 34. Dewettinck, T., Van Houtte, E., Geenens, D., Van Gege, K. and Verstraete, W.,  
13 HACCP (Hazard Analysis and Critical Control Points) to guarantee safe water  
14 reuse and drinking water production – a case study, *Water Science and*  
15 *Technology*, **43**(12), 31, 2001.
- 16 35. Dickerson, A.P., Gibson, H.D. and Tsakalotos, E., Is attack the best form of  
17 defence? A competing risk analysis of acquisition activity in the UK,  
18 *Cambridge J. Econ.*, **27**(3), 337, 2003.
- 19 36. Downey, J.M., Risks of outsourcing – applying risk management techniques to  
20 staffing methods, *Facilities*, **13**(9/10), 38, 1995.
- 21 37. Doyle G. and Grabinsky, M., Applying GIS to a water main corrosion study. *J.*  
22 *AWWA*, **93**(5), 90, 2003.
- 23 38. Drohan, W.M. and O'Connor, K., Competitor analysis can give your association  
24 the edge, *Association Management*, **50**(1), 103, 1998.
- 25 39. Egerton, A.J., *FMEA – water flowsheet*, Lectures in risk management for water  
26 and wastewater engineers, Egerton Consulting Ltd., 2004.

- 1 40. Egerton, A.J., Minimising the risk of contamination in water treatment, Lecture  
2 given at a Pipeline Industries Guild/Institute of Water Officers meeting, Bristol  
3 Water, United Kingdom, 14<sup>th</sup> February, 2004. (website:  
4 [www.egertonconsulting.co.uk](http://www.egertonconsulting.co.uk)).
- 5 41. Eisenberg, D., Soller, J., Sakaji, R. and Olivieri, A., A methodology to evaluate  
6 water and wastewater treatment plant reliability, *Wat. Sci. Technol.*, **43**(10), 91,  
7 2001.
- 8 42. Elias, D., Allocating capital risk: Who should pay?, *Wat. Engg. Manage.*,  
9 **148**(5), 61, 2001.
- 10 43. Fedra, K., Integrated risk assessment and management: overview and state of  
11 the art, *J. Haz. Mat.*, **61**, 5, 1998.
- 12 44. Feijtel, T., Boeije, G., Matthies, M., Young, A., Morris, G., Gandolfi, C.,  
13 Hansen, B., Fox, K., Matthijs, E., Koch, V., Schroder, R., Cassani, G.,  
14 Schowanek, D., Rosenblom, J. and Holt, M., Development of a geography-  
15 referenced regional exposure assessment tool for European rivers – GREAT-ER,  
16 *J. Haz. Mat.*, **61**, 59, 1998.
- 17 45. Fewtrell L. and Bartram J., *Water quality: guidelines, standards and health –*  
18 *Assessment of risk and risk management for water-related infectious disease*,  
19 IWA Publishing, London, 2001.
- 20 46. Fisher, M.L., What is the right supply chain for your product?, *Harvard*  
21 *Business Review*, **75**(2), 105, 1997.
- 22 47. Fitzpatrick, E.W., Assessing the worth of new technology, *J. Amer. Soc. of CLU*  
23 *and ChFC*, **49**(4), 37, 1995.
- 24 48. Foran, J., Brosnan, T., Connor, M., Delfino, K., Depinto, J., Dickson, K.,  
25 Humphrey, H., Novotny, V., Smith, R., Sobsey, M. and Stehman, S., A

- 1 framework for comprehensive, integrated, watershed monitoring in New York  
2 City. *Environ. Monit. Assess.* **62**, 147, 2000.
- 3 49. Foster, J.A. and McDonald, A.T., Assessing pollution risks to water supply  
4 intakes using geographic information systems (GIS), *Environ. Modelling and*  
5 *Software*, **15**, 225, 2000.
- 6 50. Foster, M., Fell, R. and Spannagle, M., A method for assessing the relative  
7 likelihood of failure of embankment dams by piping, *Can. Geotechn. J.* **37**(5),  
8 1025, 2000.
- 9 51. Fuest, S., Berlekamp, J., Klein, M. and Matthies, M., Risk hazard mapping of  
10 groundwater contamination using long-term monitoring data of shallow drinking  
11 water wells, *J. Haz. Mat.*, **61**, 197, 1998.
- 12 52. Gale, P., Developments in microbiological risk assessment for drinking water, *J.*  
13 *Appl. Microbiology*, **91**, 191, 2001.
- 14 53. Gray, R.S. and Powell, E., Risk management of major aqueducts, *J. IWEM*, **2**,  
15 594, 1988.
- 16 54. Gregory, A., The usefulness of Beta in the investment-appraisal process,  
17 *Financial Management*, **68**(1), 42, 1990.
- 18 55. Grimsey, D. and Lewis, M.K., Evaluating the risks of public private partnerships  
19 for infrastructure projects, *Int. J. Proj. Manage.*, **20**, 107, 2002.
- 20 56. Gündüz, O., Soyupak, S. and Yurteri, Development of water quality  
21 management strategies for the proposed Isikli Reservoir, *Wat. Sci. Technol.*,  
22 **37**(2), 369, 1998.
- 23 57. Haas, C.N. and Trussell, R.R., Frameworks for assessing reliability of multiple,  
24 independent barriers in potable water reuse, *Wat. Sci. Technol.*, **38**(6), 1, 1998.
- 25 58. Haas, C.N., Progress and data gaps in quantitative microbial risk assessment,  
26 *Wat. Sci. Tech.*, **46**(11), 277, 2002.

- 1 59. Haas, C.N., Rose, J.B., Gerba, C.P., *Quantitative Microbial Risk Assessment*,  
2 Wiley, NY, 1999.
- 3 60. Hagevik, S., What keeps 'em? *J. Environ. Hlth.*, **63**(6), 50, 2001.
- 4 61. Halfacree, S., Pollution risk management, *Issues in Environ. Sci. Technol.*, **9**, 37,  
5 1998.
- 6 62. Hartmann, G.C. and Lakatos, A.I., Assessing technology risk – a case study,  
7 *Res. Technol. Manage.*, **41**(2), 32, 1998.
- 8 63. Heikkilä, J. and Cordon, C., Outsourcing: a core or non-core strategic  
9 management decision?, *Strategic Change*, **11**, 183, 2002.
- 10 64. Hellier, K., Hazard analysis and critical control points for water supplies, *Proc.*  
11 *63<sup>rd</sup> Annual Water Industry Engineers and Operator's Conference*,  
12 Warrnambool, 6-7 September, 2000.
- 13 65. Hern, R., Competition and access pricing in the UK water industry, *Utilities*  
14 *Policy*, **10**, 117, 2001.
- 15 66. Hertz, D.B., Risk analysis in capital investment, *Harvard Business Review*,  
16 **42**(1), 95, 1964.
- 17 67. Hrudey, S.E. and Leiss, W., Risk management and precaution – insights on the  
18 cautious use of evidence, *Environ. Health Persp.*, **111**, 1577, 2003.
- 19 68. Hrudey, S.E., Limits to Science for Assessing and Managing Environmental  
20 Health Risks, *Science, Truth and Justice*, Canadian Institute for the  
21 Administration of Justice, Les Éditions Thémis. Faculté de Droit. Université de  
22 Montréal, pp. 128-150, 2000.
- 23 69. Hunter, P.R., Waite, M., Ronchi, E., *Drinking Water and Infectious Disease:*  
24 *Establishing the Links*, IWA Publishing, London, 2002.

- 1 70. IMPRESS Management, *IMPRESS Guidance*, Guidance for the analysis of  
2 pressures and impacts in accordance with the water framework directive, Draft  
3 5.2, European Commission, Brussels, 2002.
- 4 71. Jinno, K., Zongxue, X, Kawamura, A. and Tajiri, K., Risk assessment of a water  
5 supply system during drought, *Wat. Resource Develop.*, **11**(2), 185, 1995.
- 6 72. Kaufman, M.M. and Wurtz, M., Small system maintenance management using  
7 GIS, *J. AWWA*, **90**(8), 70, 1998.
- 8 73. Kent, N.A., Treece, D. and Davies, M., Asset management through risk  
9 assessment for Welsh Water's water trunk mains, *Proc. ICE/CIWEM*  
10 *Conference: Risk and reward in asset management delivery – who is best*  
11 *prepared for the challenges ahead?*, 14<sup>th</sup> November, 2003, London, UK.
- 12 74. Khan, F.I. and Abbasi, S.A., Towards automation of HAZOP with a new tool  
13 EXPERTOP, *Environ. Modelling and Software*, **15**, 67, 2000.
- 14 75. Kilpatrick, K. and Lapsley, I., "Trust us" – Regulators and the governance of  
15 privatized utilities, *Public Money Manage.*, **16**(2), 39, 1996.
- 16 76. Laing, R.D., *Report of the Commission of Inquiry into matters relating to the*  
17 *safety of the public drinking water in the City of North Battleford,*  
18 *Saskatchewan.*, The Queen's Printer, Regina, Saskatchewan, March 28<sup>th</sup>, 2002.  
19 (website: <http://www.northbattlefordwaterinquiry.ca>.)
- 20 77. Lantzy, R.J., Cichy, P.T. and Leitzinger, A.H., Use of geographical maps to  
21 manage risk from groundwater contamination, *Journal of Hazardous Materials*,  
22 **61**, 319, 1998.
- 23 78. Larsen, E.R. and Bunn, D.W., Deregulation in electricity: understanding  
24 strategic and regulatory risk, *J. Oper. Res. Soc.*, **50**, 337, 1999.
- 25 79. Latiffe, R., Probabilistic risk analysis of large dams: its value and limits, *Intl.*  
26 *Wat. Power and Dam Constr.*, **45**(3), 13, 1993.

- 1 80. Latinopoulos, P., Mylopoulos, N. and Mylopoulos, Y., Risk-based decision  
2 analysis in the design of water supply projects, *Wat. Resources Manage.*, **11**,  
3 263, 1997.
- 4 81. Li, S.G. and McLaughlin, D., A nonstationary spectral method for solving  
5 stochastic groundwater problems – unconditional analysis, *Wat. Resources Res.*,  
6 **27**(7), 1589, 1991.
- 7 82. Lifton, G. and Smeaton, P., Asset risk management in Scottish Water, *Proc. of*  
8 *the ICE/CIWEM Conference: Risk and reward in asset management delivery –*  
9 *who is best prepared for the challenges ahead?*, 14<sup>th</sup> November, 2003, London,  
10 UK.
- 11 83. Lindley, T.R. and Buchberger, S.G., Assessing intrusion susceptibility in  
12 distribution systems, *J. AWWA*, **94**(6), 66, 2002.
- 13 84. Liou, T-S. and Yeh, H-D., Conditional expectation for evaluation of risk  
14 groundwater flow and solute transport: one-dimensional analysis, *J. Hydrol.*,  
15 **199**, 378, 1997.
- 16 85. Littlechild, S.C., *Economic Regulation of Privatised Water Authorities*, London,  
17 HMSO, 1986.
- 18 86. Lonsdale, C., Effectively managing vertical supply relationships: a risk  
19 management model for outsourcing, *Supply Chain Manage.*, **4**(4), 176, 1999.
- 20 87. Luehrman, T.A., What's it worth? A general manager's guide to valuation,  
21 *Harvard Business Review*, **75**(3), 132, 1997.
- 22 88. Lytton, L., Howe, S., Sage, R. and Greenaway, P., Groundwater abstraction  
23 pollution risk assessment, *Wat. Sci. Technol.*, **47**(9), 1, 2003.
- 24 89. Mailhot, A. and Villeneuve, J-P., Mean-value second-order uncertainty analysis  
25 method: application to water quality modelling, *Advances in Wat. Resources*,  
26 **26**, 491, 2003.

- 1 90. Masago, Y., Katayama, H., Hashimoto, A., Hirata, T. and Ohgaki, S.,  
2 Assessment of risk of infection due to *Cryptosporidium parvum* in drinking  
3 water, *Wat. Sci. Tech.*, **46**, 319, 2002.
- 4 91. Maxwell, S., Where are we headed? Ten key trends and developments in the  
5 water industry, *J. AWWA*, **93**(4), 114, 2001.
- 6 92. McGaughey Jr., R.E., Synder, C.A. and Carr, H.H., Implementing information  
7 technology for competitive advantage: risk management issues, *Information and*  
8 *Manage.*, **26**, 273, 1994.
- 9 93. McIntyre, N.R., Wagener, T., Wheeler, H.S. and Chapra, S.C., Risk-based  
10 modelling of surface water quality: a case study of the Charles River,  
11 Massachusetts, *J. Hydrol.*, **274**, 225, 2003.
- 12 94. McNally, J.S., Retaining valued employees, *Pennsylvania CPA J.*, **71**(4), 24,  
13 2001.
- 14 95. Medema, G.J., Hoogenboezem, W., van der Veer, A.J., Ketelaars, H.A.M.,  
15 Hijnen, W.A.M. and Nobel, P.J., Quantitative risk assessment of  
16 *Cryptosporidium* in surface water treatment, *Wat. Sci. Technol.*, **47**(3), 241,  
17 2003.
- 18 96. Merabtene, T., Kawamura, A., Jinno, K. and Olsson, J., Risk assessment for  
19 optimal drought management of an integrated water resources system using a  
20 genetic algorithm, *Hydrological Processes*, **16**, 2189, 2002.
- 21 97. Modigliani and Miller, The cost of capital, corporation finance and the theory of  
22 investment, *Amer. Econ. Rev.*, **48**(3), 261, 1958.
- 23 98. Morana, C. and Sawkins, J.W., Regulatory uncertainty and share price volatility:  
24 the English and Welsh water industry's periodic price review, *J. Regul. Econ.*,  
25 **17**(1), 87, 2000.

- 1 99. Mosca, R., Schenone, M. and Bonello, A.F., Risk analysis in the evaluation of  
2 plant investments: the contribution of a non-deterministic approach, *Proj.*  
3 *Manage. J.*, **32**(3), 4, 2001.
- 4 100. Mowday, R.T., Strategies for adapting to high rates of employee turnover,  
5 *Human Resource Manage.*, **23**(4), 365, 1984.
- 6 101. Mullenger, J., Ryan, G., and Hearn, J., A water authority's experience with  
7 HACCP, *Wat. Sci. Tech: Wat. Supply*, **2**(5/6), 149, 2002.
- 8 102. Myers, S.C., Interactions of corporate financing and investment decisions –  
9 implications for capital budgeting, *J. Finance*, **29**(1), 1, 1974.
- 10 103. National Academy of Sciences, *Risk Assessment in the Federal Government:*  
11 *Managing the Process*, National Academy Press, Washington, DC, 1983.
- 12 104. Newman, W.R., Hanna, M. and Maffei, M.J., Dealing with the uncertainties of  
13 manufacturing: flexibility, buffers and integration, *Intl. J. Operations and*  
14 *Production Manage.*, **13**(1), 19, 1993.
- 15 105. NHMRC, *Framework for Management of Drinking Water Quality*, NHMRC,  
16 New Zealand, 2001.
- 17 106. NRDC, *What's on tap? Grading drinking water in US cities*, Natural Resources  
18 Defense Council, Washington DC, 2003. (website:  
19 <http://www2.nrdc.org/water/drinking/uscities/pdf.>).
- 20 107. NRWA, Security vulnerability self-assessment guide for small drinking water  
21 systems, 2002. (website:  
22 <http://www.health.ri.gov/environment/dwq/security/vulnerability.htm>).
- 23 108. O'Connor D.R., *Report of the Walkerton Inquiry. Part 1. The events of May*  
24 *2000 and related issues*, The Attorney General of Ontario, Toronto, Canada,  
25 2002.

- 1 109. O'Reilly, C.A., Chatman, J.A. and Caldwell, D., People and organizational  
2 culture: A profile comparison approach to assessing person-organization fit,  
3 *Academy of Manage. J.*, **34**(3), 487, 1991.
- 4 110. Ofwat, *Access codes for common carriage: guidance*, Ofwat, 2002. (website:  
5 <http://www.ofwat.gov.uk>).
- 6 111. Osowski, S.L., Swick Jr, J.D., Carney, G.R., Pena, H.B., Danielson, J.E. and  
7 Parrish, D.A., A watershed-based cumulative risk impact analysis:  
8 Environmental vulnerability and impact criteria, *Environ. Monit. Assess.*, **66**,  
9 159, 1999.
- 10 112. Ostfeld, A., Kogan, D. and Shamir, U., Reliability simulation of water  
11 distribution systems – single and multiquality, *Urban Water*, **4**, 53, 2002.
- 12 113. Ostfeld, A., Reliability analysis of regional water distribution systems, *Urban*  
13 *Water*, **3**, 253, 2001.
- 14 114. Parker, D., Performance, risk and strategy in privatised, regulated industries,  
15 *Intl. J. Public Sector Manage.*, **16**(1), 75, 2003.
- 16 115. Parker, D., Reducing regulatory risk: the case for a new regulatory contract with  
17 the privatized utilities, *Public Money Manage.*, **18**(4), 51, 1998.
- 18 116. Parmelee, M.A., Trends in outsourcing for water utilities, *J. AWWA*, **94**(9), 54,  
19 2002.
- 20 117. Parr, N.M. and Cullen, N., Risk management and reservoir maintenance, *J.*  
21 *IWEM*, **2**, 587, 1988.
- 22 118. Passarella, G., Vurro, M., D'Agostino, V., Guiliano, G. and Barcelona, M.J., A  
23 probabilistic methodology to assess the risk of groundwater quality degradation,  
24 *Environ. Monit. Assess.*, **79**, 57, 2001.
- 25 119. Payment, P., Richardson, L., Siemiatycki, J., Dewar, R., Edwardes, M. and  
26 Franco, E., A randomized trial to evaluate the risk of gastrointestinal disease due

- 1 to consumption of drinking water meeting currently accepted microbial  
2 standards, *Amer. J. Public Hlth.*, **81**(6), 703, 1991.
- 3 120. Phelps, R., Chan, C., Kapsalis, S.C., Does scenario planning affect  
4 performance? Two exploratory studies, *J. Business Res.*, **51**, 223, 2001.
- 5 121. Pollard, S.J.T., Strutt, J.E., MacGillivray, B.H., Hamilton, P.D. and Hrudey,  
6 S.E., Risk analysis and management in the water utility sector – a review of  
7 drivers, tools and techniques, *Trans. IChemE, Part B: Proc. Safety Environ.*  
8 **82**(B6): 453, 2004
- 9 122. Pollard, S.J.T., Yearsley, R., Reynard, N., Meadowcroft, I.C., Duarte-Davidson,  
10 R. and Duerden, S., Current directions in the practice of environmental risk  
11 assessment in the United Kingdom, *Environ. Sci. Technol.*, **36**(4): 530, 2002.
- 12 123. Portielje, R., Hvitved-Jacobsen, T. and Schaarup-Jensen, K., Risk analysis using  
13 stochastic reliability methods applied to two cases of deterministic water quality  
14 models, *Wat. Res.*, **34**(1), 153, 2000.
- 15 124. Prime Minister's Strategy Unit, *Risk: improving Government's capability to*  
16 *handle risk and uncertainty*, The Strategy Unit, London, 2002. (website:  
17 <http://www.number-10.gov.uk/SU/RISK/risk/home.html>).
- 18 125. Quélin, B. and Duhamel, F., Bringing together strategic outsourcing ad  
19 corporate strategy: outsourcing motives and risks, *Eur. Manage. J.*, **21**(5), 647,  
20 2003.
- 21 126. Radovanovic, R. and Marlin, A., Critical water mains – the need for risk  
22 analysis, *Water (Australia)*, **30** (2), 42, 2003.
- 23 127. Rajani, B.B. and Kleiner, Y., *WARP – Water Mains Renewal Planner*, National  
24 Research Council Canada, 2001. (website: [http://irc.nrc-](http://irc.nrc-cnrc.gc.ca/fulltext/nrcc44680/)  
25 [cnrc.gc.ca/fulltext/nrcc44680/](http://irc.nrc-cnrc.gc.ca/fulltext/nrcc44680/))

- 1 128. Ranasinghe, M., Private sector participation in infrastructure projects: a  
2 methodology to analyse viability of BOT, *Constr. Manage. Econ.*, **17**, 613,  
3 1999.
- 4 129. Rautman, C.A. and Istok, J.D., Probabilistic assessment of ground-water  
5 contamination: 1. Geostatistical framework, *Ground Water*, **34**(5), 899, 1996.
- 6 130. Remenyi, D. and Heafield, A., Business process re-engineering: some aspects of  
7 how to evaluate and manage the risk exposure, *Intl. J. Proj. Manage.*, **14**(6),  
8 349, 1996.
- 9 131. Rizak, S., Cunliffe, D., Sinclair, M., Vulcano, R., Howard, J., Hrudey, S. and  
10 Callan, P., Drinking water quality management: a holistic approach, *Wat. Sci.*  
11 *Tech.*, **47**(9), 31, 2003.
- 12 132. Rogers, L.L., Dowla, F.U. and Johnson, V.M., Optimal field-scale groundwater  
13 remediation using neural networks and the genetic algorithm, *Environ. Sci.*  
14 *Technol.*, **29**, 1145, 1995.
- 15 133. Rothschild, W.E., Competitor analysis: the missing link in strategy, *The*  
16 *McKinsey Quarterly*, **3**, 42, 1979.
- 17 134. Rothstein, E. and Kiyosaki, D., Development of a strategic plan: Portfolio  
18 management for public utilities, *J. AWWA*, **95**(1), 52, 2003.
- 19 135. Saal, D.S. and Parker, D., Productivity and price performance in the privatized  
20 water and sewerage companies of England and Wales, *Journal of Regul. Econ.*,  
21 **20**(1), 61, 2001.
- 22 136. Sawkins, J.W., The development of competition in the English and Welsh water  
23 and sewerage industry, *Fiscal Studies*, **22**(2), 189, 2001.
- 24 137. Sawkins, J.W., Yardstick competition in the English and Welsh water industry:  
25 Fiction or reality?, *Utilities Policy*, **5**(1), 27, 1995.

- 1 138. Seidenstat, P., *Emerging competition in water and wastewater industries*.  
2 Universities Council on Water Resources, 2000. (website:  
3 [www.ucowr.siu.edu/updates/pdf/V117\\_A2.pdf](http://www.ucowr.siu.edu/updates/pdf/V117_A2.pdf)).
- 4 139. Seker, D.Z., Kadbasli, S. and Rudvan, B., Risk assessment of a dam-break using  
5 GIS technology, *Wat. Sci. Technol.*, **48**(10), 89, 2003.
- 6 140. Sharpe, W.F., Capital asset prices: a theory of market equilibrium under  
7 conditions of risk, *J. Finance*, **19**(3), 425, 1964.
- 8 141. Sheridan, J.E., Organizational culture and employee retention, *Academy*  
9 *Manage. J.*, **35**(5), 1036, 1992.
- 10 142. Shimoda, T.A., Emergency preparedness and response, *J. AWWA*, **86**, 84, 1994.
- 11 143. Shleifer, A., A theory of yardstick competition, *Rand J. Econ.*, **16**(3), 319, 1985.
- 12 144. Sigler, K.J., Challenges of employee retention, *Manage. Res. News*, **22**(10), 1,  
13 1999.
- 14 145. Singh, H. and Harianto, F., Management-board relationships, takeover risk, and  
15 the adoption of golden parachutes, *Academy Manage. J.*, **32**(1), 7, 1989.
- 16 146. Sivertun, A. and Prange, L., Non-point source critical area analysis in the  
17 Gisselö watershed using GIS, *Environ. Modelling and Software*, **18**, 887, 2003.
- 18 147. SNL news release, *Sandia develops program to assess water infrastructure*  
19 *vulnerabilities*, October 3<sup>rd</sup>, 2001. (website:  
20 <http://www.sandia.gov/media/NewsRel/NR2001/watinfr.htm>).
- 21 148. Songer, A.D., Diekmann, J. and Pecsok, R.S., Risk analysis for revenue  
22 dependent infrastructure projects, *Constr. Manage. Econ.*, **15**, 377, 1997.
- 23 149. Stahl, G.R. and Elliott, J.C., ‘New generation’ computer models for risk-based  
24 planning and management, *Water Supply (Australia)*, **17**(3/4), 289, 1999.

- 1 150. Stevens, I.M. and Lloyd, R.I., *Water resources: Sustainable optimisation and*  
2 *security of supply, a proven example*, A paper presented to the 2004 Water  
3 sources conference and exposition, Jan 11-14th, 2004, Austin, Texas.
- 4 151. Strutt, J.E., *Reliability data and sources*, Lectures in risk management for water  
5 and wastewater engineers, Cranfield University, Cranfield, UK, 2004.
- 6 152. Sweeney, M.W., Geographic information systems, *Wat. Environ. Res.*, **71**(5),  
7 551, 1999.
- 8 153. Ta, C.T., A probability model for burst risk studies of water mains, *Wat. Sci.*  
9 *Technol.: Water Supply*, **2**(4), 29, 2001.
- 10 154. Tanyimboh, T.T., Availability of water in distribution systems, *Proc. Decision*  
11 *Support in the Water Industry Under Conditions of Uncertainty, ACTUI2004*.  
12 24-25<sup>th</sup> March, 2004, Exeter, UK.
- 13 155. Tebutt, R.J., Guy, J.A., Gochin, R.J. and Lester, J.N., Requirements of a capital  
14 investment appraisal technique for the water industry in England and Wales,  
15 *Eur. Wat. Manage.*, **4**(3), 47, 2001.
- 16 156. Teunis, P.F.M., Medema, G.J, Kruidenier, L. and Havelaar, A.H., Assessment of  
17 the risk of infection by *Cryptosporidium* or *Giardia* in drinking water from a  
18 surface water source, *Wat. Res.*, **31**(6), 1333, 1997.
- 19 157. Thomas, H., Risk analysis and the formulation of acquisition / diversification  
20 strategies, *Long Range Planning* **16**(2), 28, 1983.
- 21 158. Thompson, R., Secrets to keeping good employees, *Business Credit*, **102**(1), 68,  
22 2000.
- 23 159. UK Offshore Oil Operators Association (UKOOA), *Industry guidelines on a*  
24 *framework for risk related decision support*, UKOOA, London, 1999.
- 25 160. UKWIR, *Managing microbial and chemical risks from source to tap*, Report  
26 03/DW/02/31, UK Water Industry Research Limited, London, 2003.

- 1 161. Umweltbundesamt, Water safety conference abstracts, Scholl, O. and Chorus, I.,  
2 Eds., Berlin, 28-30<sup>th</sup> April 2003.
- 3 162. US Department of Energy (USDOE), *Example process hazard analysis of a*  
4 *department of energy water chlorination process*, USDOE, Washington DC,  
5 1993. (website: [http://tis-hq.eh.doe.gov/chem\\_safety/haz\\_analysis.html](http://tis-hq.eh.doe.gov/chem_safety/haz_analysis.html))
- 6 163. US General Accounting Office (USGAO), *Water infrastructure: Comprehensive*  
7 *asset management has potential to help utilities better identify needs and plan*  
8 *future investments*, USGAO, 2004. (website:  
9 <http://www.gao.gov/new.items/d04461.pdf>).
- 10 164. Verro, R., Calliera, M., Maffioli, G., Auteri, D., Sala, S., Finizio, A. and Vighi,  
11 M., GIS-based system for surface water risk assessment of agricultural  
12 chemicals. 1. Methodological approach, *Environ. Sci. Technol.*, **36**, 1532, 2002.
- 13 165. Wang, J., Yuan, X., Zhang, Y. and Zhang, Y., A reliability and risk analysis  
14 system for multipurpose reservoir operation, *Environ. Fluid Mech.*, **3**, 289,  
15 2003.
- 16 166. Westerhoff, G.P, Pathways to higher performance, *J. AWWA*, **95**(7), 50-57,  
17 2003.
- 18 167. WHO, *Guidelines for drinking water quality, 3<sup>rd</sup> Edition* (draft), WHO, 2003.  
19 (website: [http://www.who.int/water\\_sanitation\\_health/dwq/guidelines3rd/en/](http://www.who.int/water_sanitation_health/dwq/guidelines3rd/en/)).
- 20 168. WHO, *Water safety plans (revised draft)*, Report publication  
21 WHO/SDE/WSH/02.09, World Health Organisation, 2002.
- 22 169. Wickham, J.D. and Wade, T.G., Watershed level risk assessment of nitrogen  
23 and phosphorus export, *Computers and Electronics in Agriculture*, **37**, 15, 2002.
- 24 170. Wildemann, H., Justification on strategic planning for new technologies, *Human*  
25 *Syst. Manage.*, **6**, 253, 1986.

- 1 171. Wingle, W.L., Poeter, E.P. and McKenna, S.A., UNCERT: geostatistics,  
2 uncertainty analysis and visualization software applied to groundwater flow and  
3 contaminant transport modeling, *Computers and Geosciences*, **25**, 365, 1999.
- 4 172. World Bank, *Toolkits for private participation in water and sanitation*, World  
5 Bank, 1997. (website:  
6 <http://www.worldbank.org/html/fpd/water/wstoolkits/index.html>).
- 7 173. Ye, S. and Tiong, R.L.K., NPV-at-risk method in infrastructure project  
8 investment valuation, *J. Constr. Engg. Manage.*, **126**(3), 227, 2000.
- 9 174. Zongxue, X., Jinno, K., Kawamura, A., Takesaki, S. and Ito, K., Performance  
10 risk analysis for Fukuoka water supply system, *Wat. Resources Manage.*, **12**, 13,  
11 1998.
- 12 175. Zoppou, C., Review of urban storm water models, *Environ. Modelling and*  
13 *Software*, **16**, 195, 2001.
- 14 176. Zsidisin, G.A., Panelli, A. and Upton, R., Purchasing organization involvement  
15 in risk assessments, contingency plans, and risk management: an exploratory  
16 study, *Supply Chain Manage.*, **5**(4), 187, 2000.

1  
2  
3  
4  
5  
6  
7  
8  
9  
10  
11  
12  
13  
14  
15  
16  
17  
18  
19  
20  
21  
22  
23  
24  
25  
26

**Figure Captions**

- Figure 1.* Decision Framework for the Offshore Oil Industry (UK Oil Operators Association<sup>159</sup> with permission).
- Figure 2.* The risk hierarchy (adapted from Prime Minister’s Strategy Unit<sup>124</sup>).
- Figure 3.* Technology risk algorithm (Hartmann and Lakatos<sup>62</sup>).
- Figure 4.* Illustrative fault tree for turbidity non-compliance (Demotier *et al.*<sup>31</sup>).
- Figure 5.* Reliability block diagrams (Cyna<sup>29</sup>).
- Figure 6.* Risk-based workforce planning (after Pollard *et al.*<sup>122</sup>).
- Figure 7.* Methodology for reliability analysis of a water treatment plant (Cyna<sup>29</sup>).

1

2

3

4

5

6

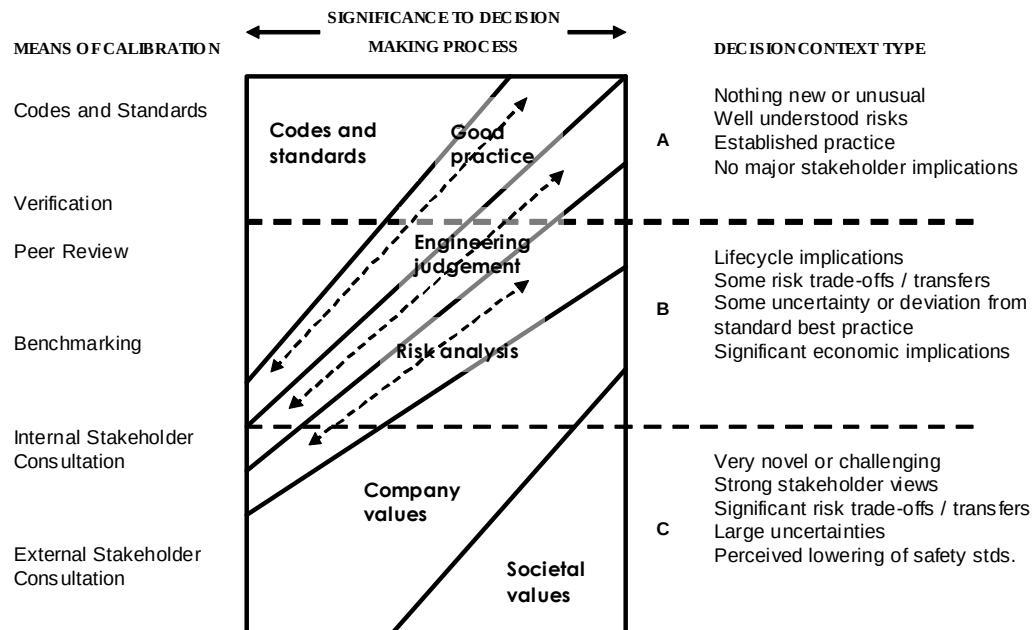


Figure 1. Decision Framework for the Offshore Oil Industry (UK Oil Operators Association<sup>159</sup> with permission).



1  
2  
  
3  
4  
5  
6  
7  
8  
9  
10  
11  
12  
13  
14  
15  
16  
17  
18  
19  
20  
21  
22  
23  
24



Figure 2. The risk hierarchy (adapted from Prime Minister’s Strategy Unit<sup>124</sup>).


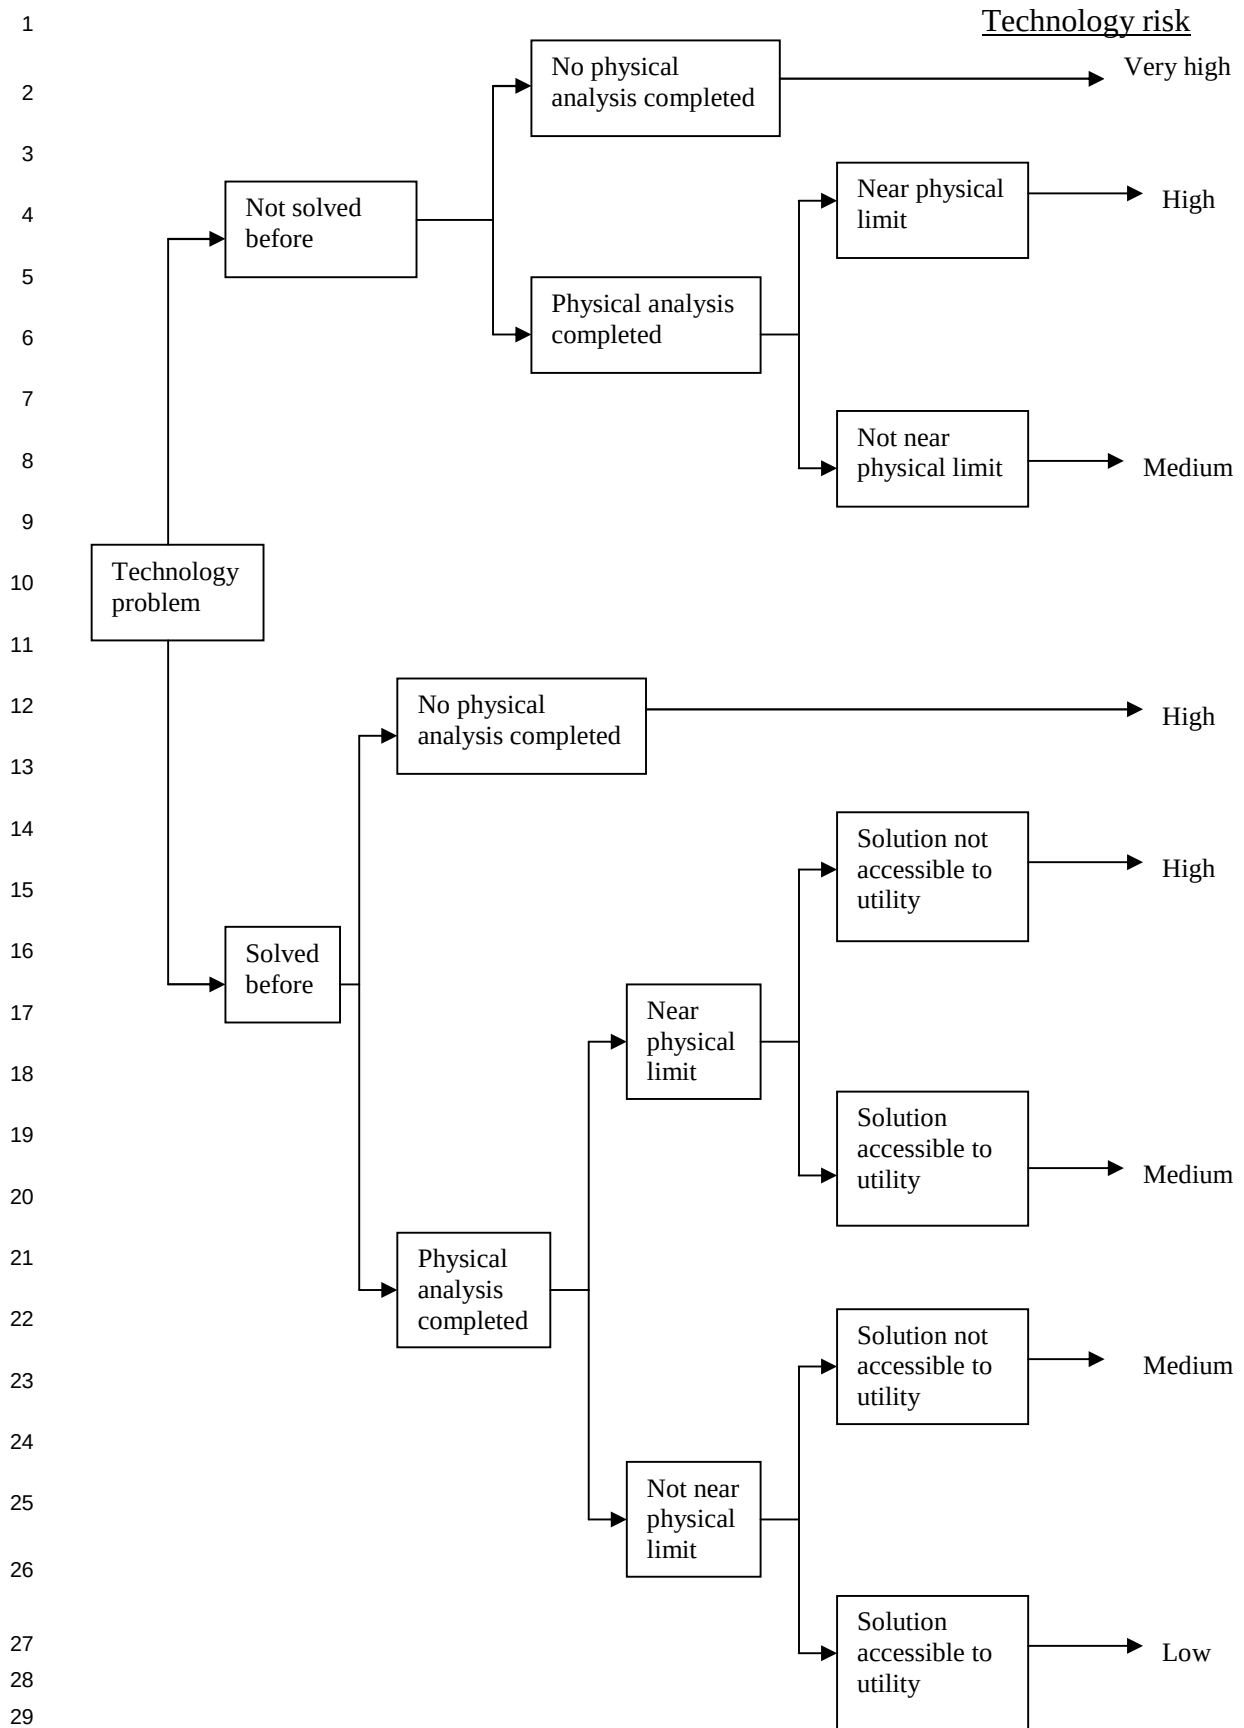


Figure 3. Technology risk algorithm (Hartmann and Lakatos<sup>62</sup> with permission).

1

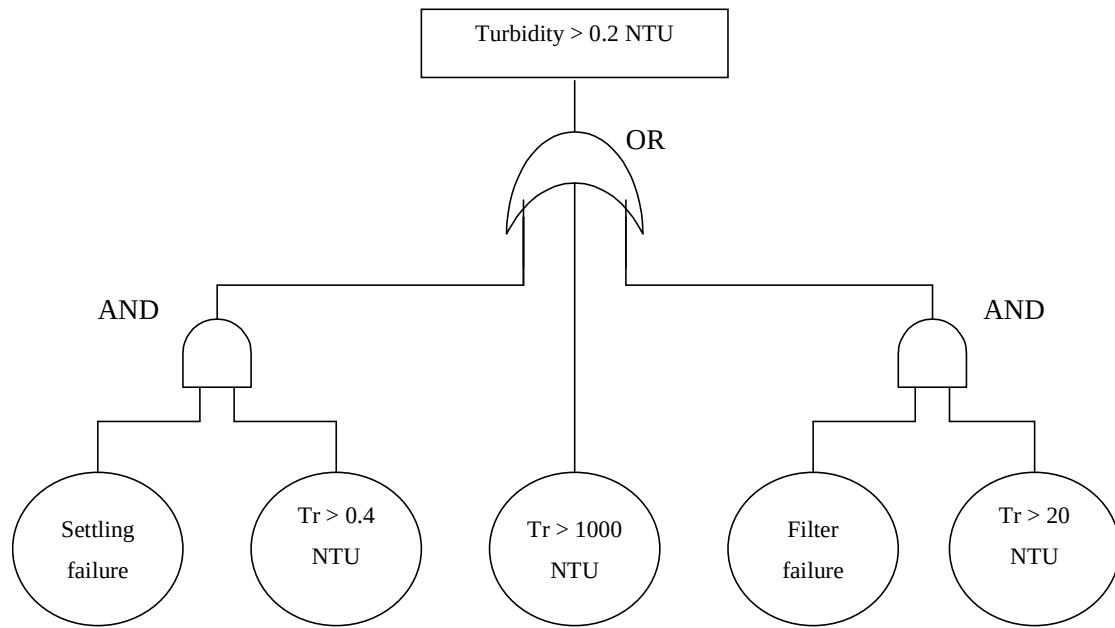

2

3 Tr = resource turbidity

4 The probability of the top-event may be calculated if the probabilities of the sub-events are known or  
 5 estimable.

6

7 *Figure 4. Illustrative fault tree for turbidity non-compliance (after Demotier *et al.*<sup>31</sup>).*

8

9

10

11

12

13

14

15


16

17


18

19

- a) Series diagram – here, the system / process is working if A1 and A2 are working



- b) Parallel diagram – here, the system / process is working if A1 or A2 are working

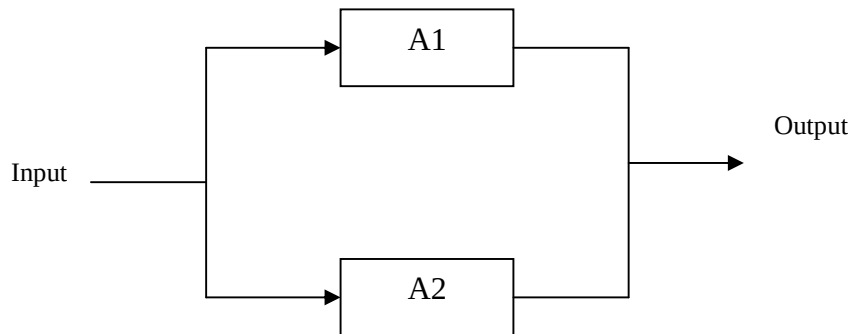

- c) Redundancy diagram – here, the system / process is working if at least  $r$  elements among  $n$  are working


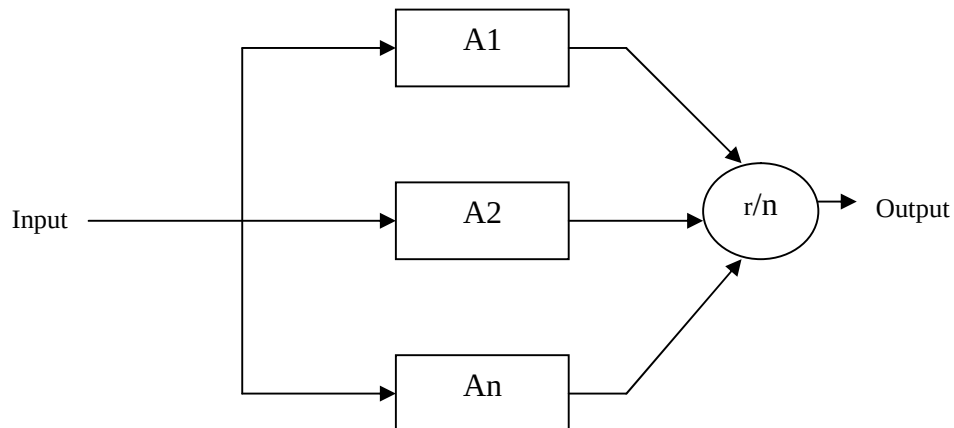


Figure 5. Reliability block diagrams (after Cyna<sup>29</sup>).

1

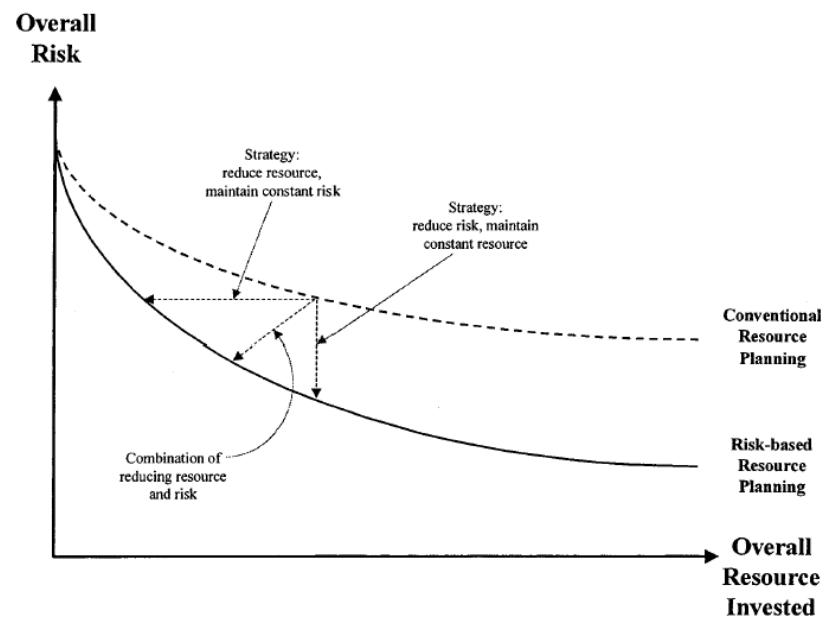

2

3

4

5

Figure 6. Risk-based workforce planning (after Pollard *et al.*<sup>122</sup>).

6

7

8

9

10

11

12

13

14

15

16

17

18

19

20

21

22

23

24

25

26

27

28

29

30

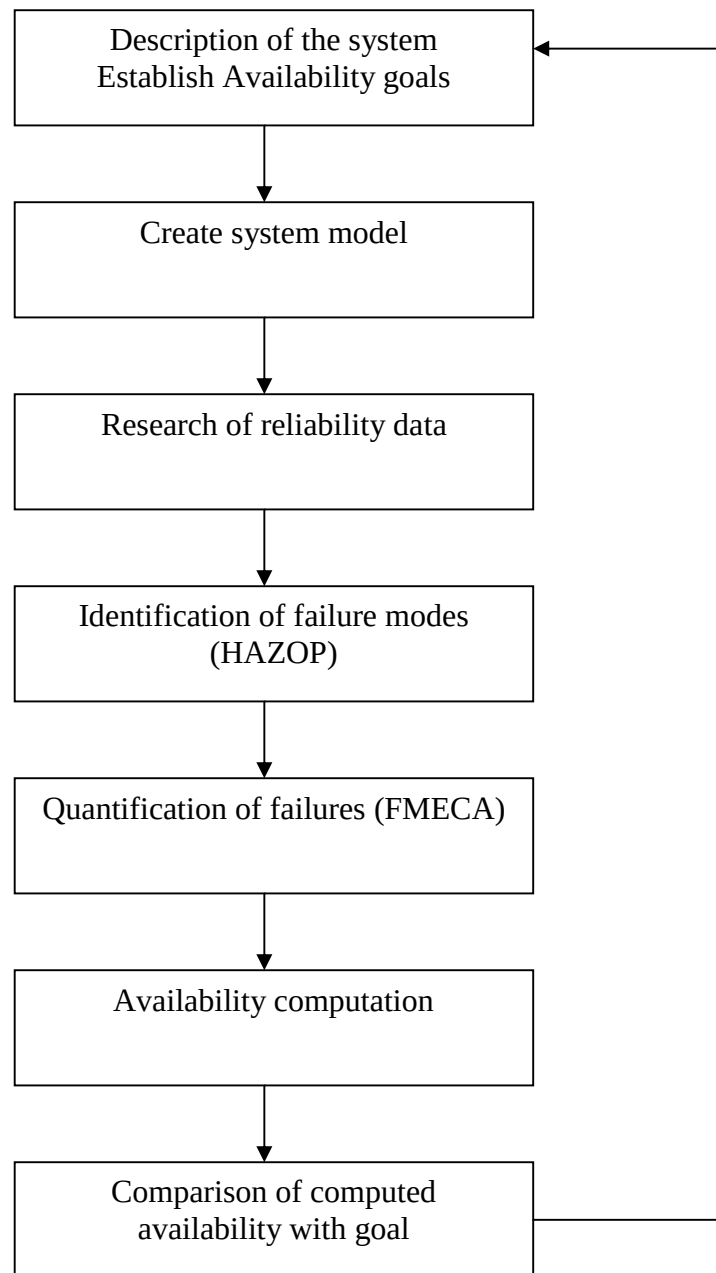


Figure 7. Methodology for reliability analysis of a water treatment plant (after Cyna<sup>29</sup>).

Table 1. Strategic risk portfolio.

| Context             | Tool / Technique                     | Application                                                                                 | Reference                                                                                                                                                                      |
|---------------------|--------------------------------------|---------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| Regulatory risk     | Ex-post modelling                    | Interpreting / evaluating the relationship between stock risk and regulatory events         | Buckland and Fraser, <sup>19</sup> Morana and Sawkins. <sup>98</sup>                                                                                                           |
|                     | Ex-ante modelling                    | Modelling evolution of regulatory environment                                               | Larssen and Bunn, <sup>78</sup> Bunn <i>et al.</i> <sup>20</sup>                                                                                                               |
| Competition risks   |                                      |                                                                                             |                                                                                                                                                                                |
| 1) Comparative      | Competitor analysis                  | Reducing price review uncertainty (and conventional benefits)                               | Drohan and O' Connor, <sup>38</sup> Rothschild. <sup>133</sup>                                                                                                                 |
| 2) Capital market   | Screening                            | Tracking take-over risk                                                                     |                                                                                                                                                                                |
|                     | Investment analysis                  | Evaluating take-over opportunity                                                            | Thomas. <sup>157</sup>                                                                                                                                                         |
| 3) For the market   | Investment analysis                  | Evaluating joint venture                                                                    | Ranasinghe, <sup>128</sup> Grimsey and Lewis. <sup>55</sup>                                                                                                                    |
| 4) Product market   | Competitor identification / analysis | Minimising competitive threats                                                              | Rothschild, <sup>133</sup> Drohan and O' Connor. <sup>38</sup>                                                                                                                 |
|                     | Investment analysis                  | Evaluating <i>de facto</i> take-over                                                        |                                                                                                                                                                                |
| BPR risks           | Scenario planning                    | Exploring potential BPR outcomes                                                            | Clemons. <sup>23</sup>                                                                                                                                                         |
|                     | Quantitative 'risk of failure'       | Evaluating success likelihood of BPR efforts                                                | Crowe <i>et al.</i> <sup>28</sup>                                                                                                                                              |
|                     | Risk matrix                          | Appraising and comparing risks of BPR strategies                                            | Remeyi and Heafield. <sup>130</sup>                                                                                                                                            |
| 1) New technology   | Risk matrix                          | Appraising and comparing risks of new technology projects                                   | McGaughey <i>et al.</i> <sup>92</sup>                                                                                                                                          |
|                     | Risk algorithm                       | Characterising risk of new technology 'problems'                                            | Hartmann and Lakatos. <sup>62</sup>                                                                                                                                            |
|                     | Checklist                            | Minimising risk of new technology introduction                                              | Hartmann and Lakatos. <sup>62</sup>                                                                                                                                            |
|                     | Profile                              | Guiding strategic technology planning                                                       | Wildemann. <sup>170</sup>                                                                                                                                                      |
| Outsourcing         | Outsourcing decision models          | Evaluating core competencies and appraising market opportunities for outsourcing candidates | Quélin and Duhamel, <sup>125</sup> Lonsdale. <sup>86</sup>                                                                                                                     |
|                     | Scenario planning                    | Exploring 'what-if' scenarios                                                               | Zsidisin <i>et al.</i> <sup>176</sup>                                                                                                                                          |
| Employee retention  | OCP                                  | Evaluating 'cultural fit' of prospective employees                                          | Sheridan, <sup>141</sup> O'Reilly <i>et al.</i> <sup>109</sup>                                                                                                                 |
|                     | Early warning system                 | Identification of 'at-risk' employee groups                                                 | McNally. <sup>94</sup>                                                                                                                                                         |
|                     | Gap analysis                         | To assess employee development and benefit schemes                                          |                                                                                                                                                                                |
|                     | Checklist                            | Informal assessment of retention risk                                                       | Anon. <sup>4</sup>                                                                                                                                                             |
| Investment analysis |                                      |                                                                                             |                                                                                                                                                                                |
| 1) Assets-in-place  | NPV / IRR                            | Valuation of an ongoing business or some part of one                                        | Barriex <i>et al.</i> , <sup>10</sup> Mosca <i>et al.</i> , <sup>99</sup> ADB, <sup>6</sup> Burchett and Tummala, <sup>21</sup> Luehrman, <sup>87</sup> Thomas. <sup>157</sup> |
|                     | Strategic portfolio planning         | Creating a balanced utility investment portfolio                                            | Rothstein and Kiyosaki. <sup>134</sup>                                                                                                                                         |
| 2) Opportunities    | Option pricing theory                | Valuation of possible future operations                                                     | Luehrman, <sup>87</sup> Black and Scholes. <sup>14</sup>                                                                                                                       |
| 3) Joint Ventures   | NPV / IRR                            | Valuation of prospective partnerships, strategic alliances                                  | Grimsey and Lewis, <sup>55</sup> Ranasinghe, <sup>128</sup> Luehrman. <sup>87</sup>                                                                                            |

Table 2. BPR risk matrix (after Remenyi and Heafield<sup>130</sup>).

| <i>Indicate the 10 most relevant factors</i>              |                                    |
|-----------------------------------------------------------|------------------------------------|
| FACTORS                                                   | FACTORS                            |
| BUSINESS RISKS                                            | CORPORATE CULTURE                  |
| Change to business scope ( <i>e.g.</i> from diversifying) | Staff attitude to technology       |
| Change to market structures                               | Staff attitude to changes          |
| Change of regulatory relationship                         | Staff attitude to senior managers  |
| Change of supplier relationship                           | Managerial style                   |
| Impact on (potential) ‘competitors’                       | Positive shared vision             |
| FINANCIAL RISKS                                           | TECHNOLOGY                         |
| Funded from current cash flow                             | Size of project                    |
| Funded from new equity                                    | Structuredness of project          |
| Funded from long term debt                                | Complexity of technology           |
| Funded from short term debt                               | Complexity of application          |
|                                                           | Novelty of technology              |
| CORPORATE STRUCTURE                                       | Novelty of application             |
| Bureaucratic structure                                    | Impact on technical infrastructure |
| Outsourcing utilisation                                   |                                    |
| Flexibility of job positions                              | HUMAN                              |
|                                                           | Skills base                        |

Table 3. Programme level risk portfolio.

| Context                  | Tool / Technique                       | Application                                                                                                                                                                                           | Reference                                                                                                                                                                                                                                                                                                             |
|--------------------------|----------------------------------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| Asset management         | Risk ranking                           | Prioritisation of remedial work on infrastructure assets                                                                                                                                              | Kent <i>et al.</i> , <sup>73</sup> Radovanovic and Marlin, <sup>126</sup> Foster <i>et al.</i> <sup>50</sup>                                                                                                                                                                                                          |
|                          | FMECA                                  | ‘Source to tap’ risk identification and prioritisation                                                                                                                                                | Lifton and Smeaton. <sup>82</sup>                                                                                                                                                                                                                                                                                     |
|                          | Logic models                           | Evaluating structural failure modes                                                                                                                                                                   | Gray and Powell, <sup>53</sup> Parr and Cullen. <sup>117</sup>                                                                                                                                                                                                                                                        |
|                          | GIS risk tracking                      | Infrastructure risk-tracking, visualisation and communication                                                                                                                                         | Kaufman and Wurtz. <sup>72</sup>                                                                                                                                                                                                                                                                                      |
|                          | GIS spatial analysis                   | Risk-mapping of infrastructure                                                                                                                                                                        | Doyle and Grabinski, <sup>37</sup> Ta. <sup>153</sup>                                                                                                                                                                                                                                                                 |
|                          | GIS risk simulation                    | Evaluating degradation risk                                                                                                                                                                           | Lindley and Buchberger, <sup>83</sup> Besner <i>et al.</i> <sup>13</sup>                                                                                                                                                                                                                                              |
| Catchment management     | Risk ranking                           | Prioritisation of monitoring strategies                                                                                                                                                               | Dabrowski <i>et al.</i> , <sup>30</sup> Verro <i>et al.</i> , <sup>164</sup> Boak and Packman, <sup>15</sup> Feijtel <i>et al.</i> <sup>44</sup>                                                                                                                                                                      |
|                          | GIS risk mapping                       | Mapping areas of catchment critical to water quality                                                                                                                                                  | Lytton <i>et al.</i> , <sup>88</sup> Sivertun and Prange, <sup>146</sup> Wickham and Wade, <sup>169</sup> Foster and McDonald, <sup>49</sup> Osowski <i>et al.</i> , <sup>111</sup> Fuest <i>et al.</i> , <sup>51</sup> Lantzy. <sup>77</sup>                                                                         |
|                          | Contaminant flow / transport modelling | Projecting degradation patterns / assessing risk of water quality violation                                                                                                                           | Anderson and Destouni, <sup>2</sup> Gündüz <i>et al.</i> , <sup>56</sup> Halfacree, <sup>61</sup> Liou and Yeh, <sup>84</sup> Cole <i>et al.</i> <sup>25</sup>                                                                                                                                                        |
|                          | Kriging                                | Projecting degradation patterns with limited sample data ( <i>e.g.</i> groundwater)                                                                                                                   | Passarella <i>et al.</i> , <sup>118</sup> Wingle <i>et al.</i> , <sup>171</sup> Rautman and Istok. <sup>129</sup>                                                                                                                                                                                                     |
|                          | GIS risk simulation                    | Quantified risk mapping over space <i>and</i> time                                                                                                                                                    | Dabrowski <i>et al.</i> , <sup>30</sup> Verro <i>et al.</i> , <sup>164</sup> Feijtel <i>et al.</i> <sup>44</sup>                                                                                                                                                                                                      |
| Network analysis         | Network reliability modelling          | a) Assess susceptibility to supply-demand scenarios; b) aid development of supply strategies and policies; c) assist design of distribution networks; and d) inform the need for capital expenditure. | Stevens and Lloyd, <sup>150</sup> Lifton and Smeaton, <sup>82</sup> Wang <i>et al.</i> , <sup>165</sup> Merabtene <i>et al.</i> , <sup>96</sup> Ostfeld, <sup>113</sup> Stahl and Elliot, <sup>149</sup> Zongxue <i>et al.</i> , <sup>174</sup> Andreu <i>et al.</i> , <sup>3</sup> Jinno <i>et al.</i> <sup>71</sup> |
| Vulnerability assessment | RAM-W                                  | To assess system vulnerabilities and develop measures to reduce risks of attack.                                                                                                                      | SNL news release. <sup>147</sup>                                                                                                                                                                                                                                                                                      |
|                          | Questionnaire-based self assessment    | As above                                                                                                                                                                                              | NRWA. <sup>107</sup>                                                                                                                                                                                                                                                                                                  |

Table 4. Component FMEA for chlorine cylinder and outlet valve (Egerton<sup>39</sup> with permission of Egerton Consulting Ltd.).

| Failure mode                                      | Failure effect on process                              | Failure effect on system                                              | Methods of Detection                                            | Comments                                                                           |
|---------------------------------------------------|--------------------------------------------------------|-----------------------------------------------------------------------|-----------------------------------------------------------------|------------------------------------------------------------------------------------|
| Fail to open /<br>Reduced output /<br>No output   | Loss of adequate chlorination                          | Non-potable water will leave plant                                    | Changeover should detect loss of supply                         | System failure would require combination of loss of flow and failure of changeover |
| Fail to close                                     | None – changeover should transfer to standby cylinders | None                                                                  | None                                                            |                                                                                    |
| Excess output                                     | Excess chlorination                                    | Possible taste and odour complaints. No serious consequences          | Changeover should detect excess chlorine flow                   |                                                                                    |
| Outside specification (wrong or contaminated gas) | Outside specification (wrong or contaminated gas)      | Non-potable water will leave plant. POTENTIAL FOR MAJOR SAFETY HAZARD | QA checks on delivery. Low chlorine residual readings and alarm |                                                                                    |

Table 5. Operational level risk portfolio.

| Context              | Tool / Technique              | Application                                                       | Reference                                                                      |
|----------------------|-------------------------------|-------------------------------------------------------------------|--------------------------------------------------------------------------------|
| Compliance risk      | Risk ranking                  | Prioritisation of plant contamination risks                       | Egerton. <sup>40</sup>                                                         |
|                      | QMRA                          | Assessing public health risk from microbial source contamination  | Medema <i>et al.</i> , <sup>95</sup><br>Teunis <i>et al.</i> <sup>156</sup>    |
|                      | End-of-pipe compliance models | Assessing risk of exceeding water quality standards               | Demotier <i>et al.</i> , <sup>3</sup><br>Trussell. <sup>57</sup>               |
|                      | GIS simulation                | Assessing risk of distribution system water quality degradation   | Lindley and Bucher<br><i>et al.</i> <sup>13</sup>                              |
| Reliability analysis | HACCP                         | Identifying ‘critical control points’                             | Mullenger <i>et al.</i> ,<br><i>al.</i> , <sup>34</sup> Hellier. <sup>64</sup> |
|                      | HAZOP                         | Evaluating deviations from design intent                          | US Department of<br>and Abassi. <sup>74</sup>                                  |
|                      | FMECA                         | Evaluating component failures                                     | Lifton and Smeaton                                                             |
|                      | Logic modelling               | Modelling process risk interactions                               | Demotier <i>et al.</i> , <sup>3</sup>                                          |
|                      | Multiple barrier approach     | Assessing the reliability of multiple barrier treatment processes | Demotier <i>et al.</i> , <sup>3</sup><br>Haas and Trussell                     |



**DSPACE**

<https://dspace.org/>

## **Risk analysis strategies in the water utility sector: an inventory of applications for better and more credible decision-making**

**MacGillivray, Brian H.; Hamilton, Paul D.; Strutt, J. E.; Pollard, Simon J. T.**

**2006-03-01T00:00:00Z**

Taylor & Francis

<http://dx.doi.org/10.1080/10643380500531171>

MacGillivray, B.H., Hamilton, P.D., Strutt, J.E. and Pollard, S.J.T. Risk analysis strategies in the water utility sector: an inventory of applications for better and more credible decision-making. *Critical Reviews in Environmental Science and Technology*, Vol. 36(2), Mar-Aprl 2006 , pp. 85-139.